



LTC Terry Kiehn
SOH Manager
615-313-0567
Cell 615-418-3624

MAJ James Roberts
Safety Specialist
615-313-3126
Cell 615-517-0989

SFC Harvey White
Safety Specialist
615-313-3124
Cell 615-330-0430

OFFICE FAX: 615-313-
0720

Agenda


- OSHA Requirement
- Safety Home Page
 - ✓ Facts Sheet
 - ✓ Emergency Action Plan
 - ✓ Inspections Sheets
- Safety Occupational Health Program
 - ✓ Accidents
 - ✓ Hazards




Mandatory OSHA Training

- Emergency & Fire Plan
- Hazard Communication (Hazcom)
(Right to Know)
- Personal Protective Equipment (PPE)
- Portable Fire Extinguishers
- Recordkeeping



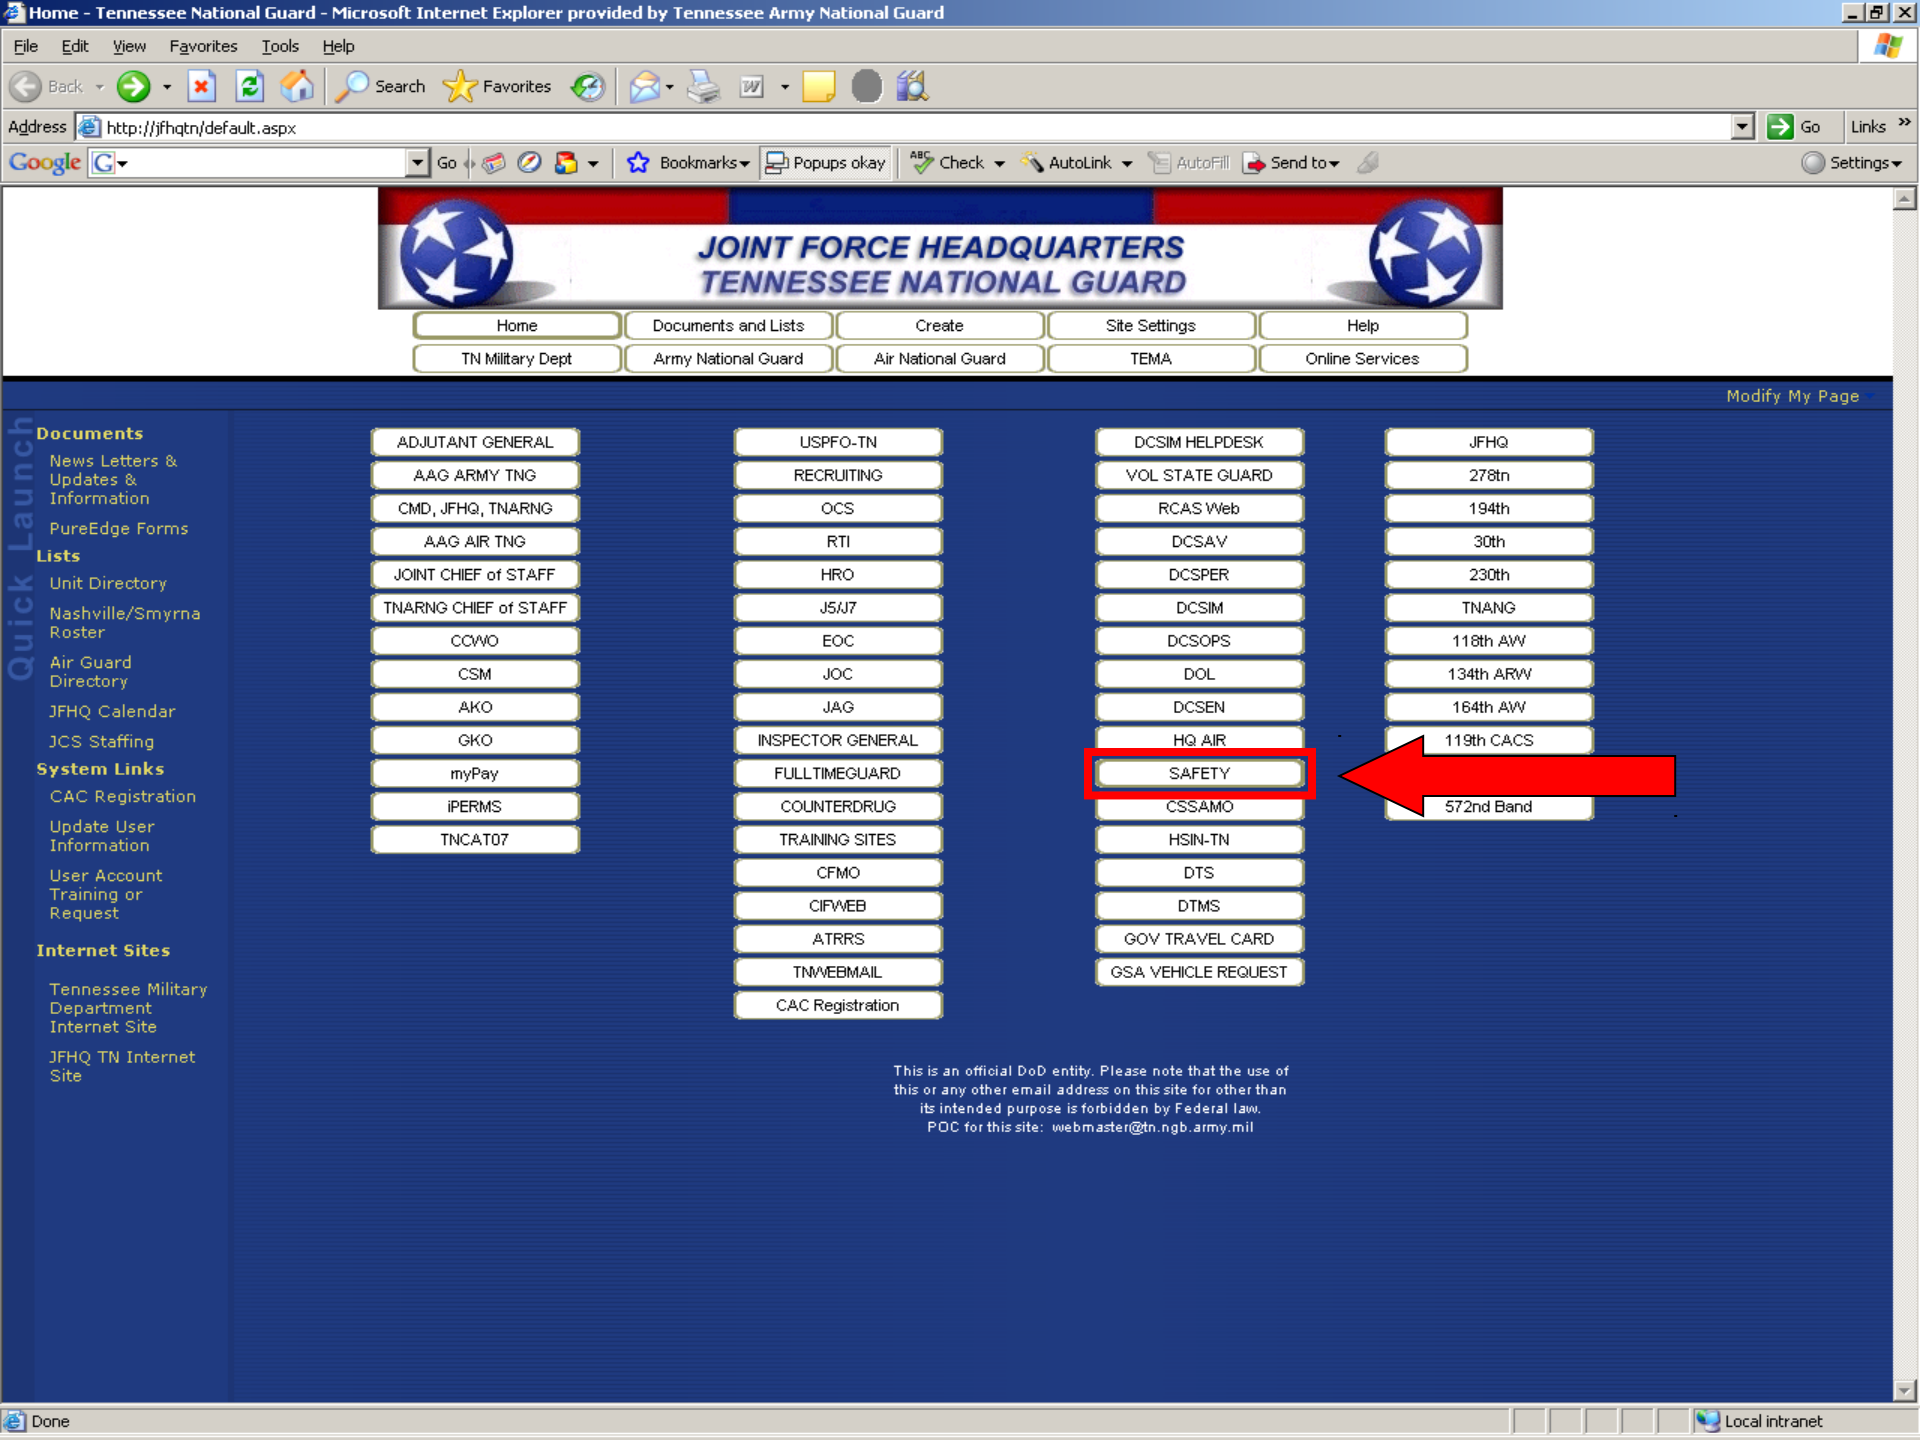

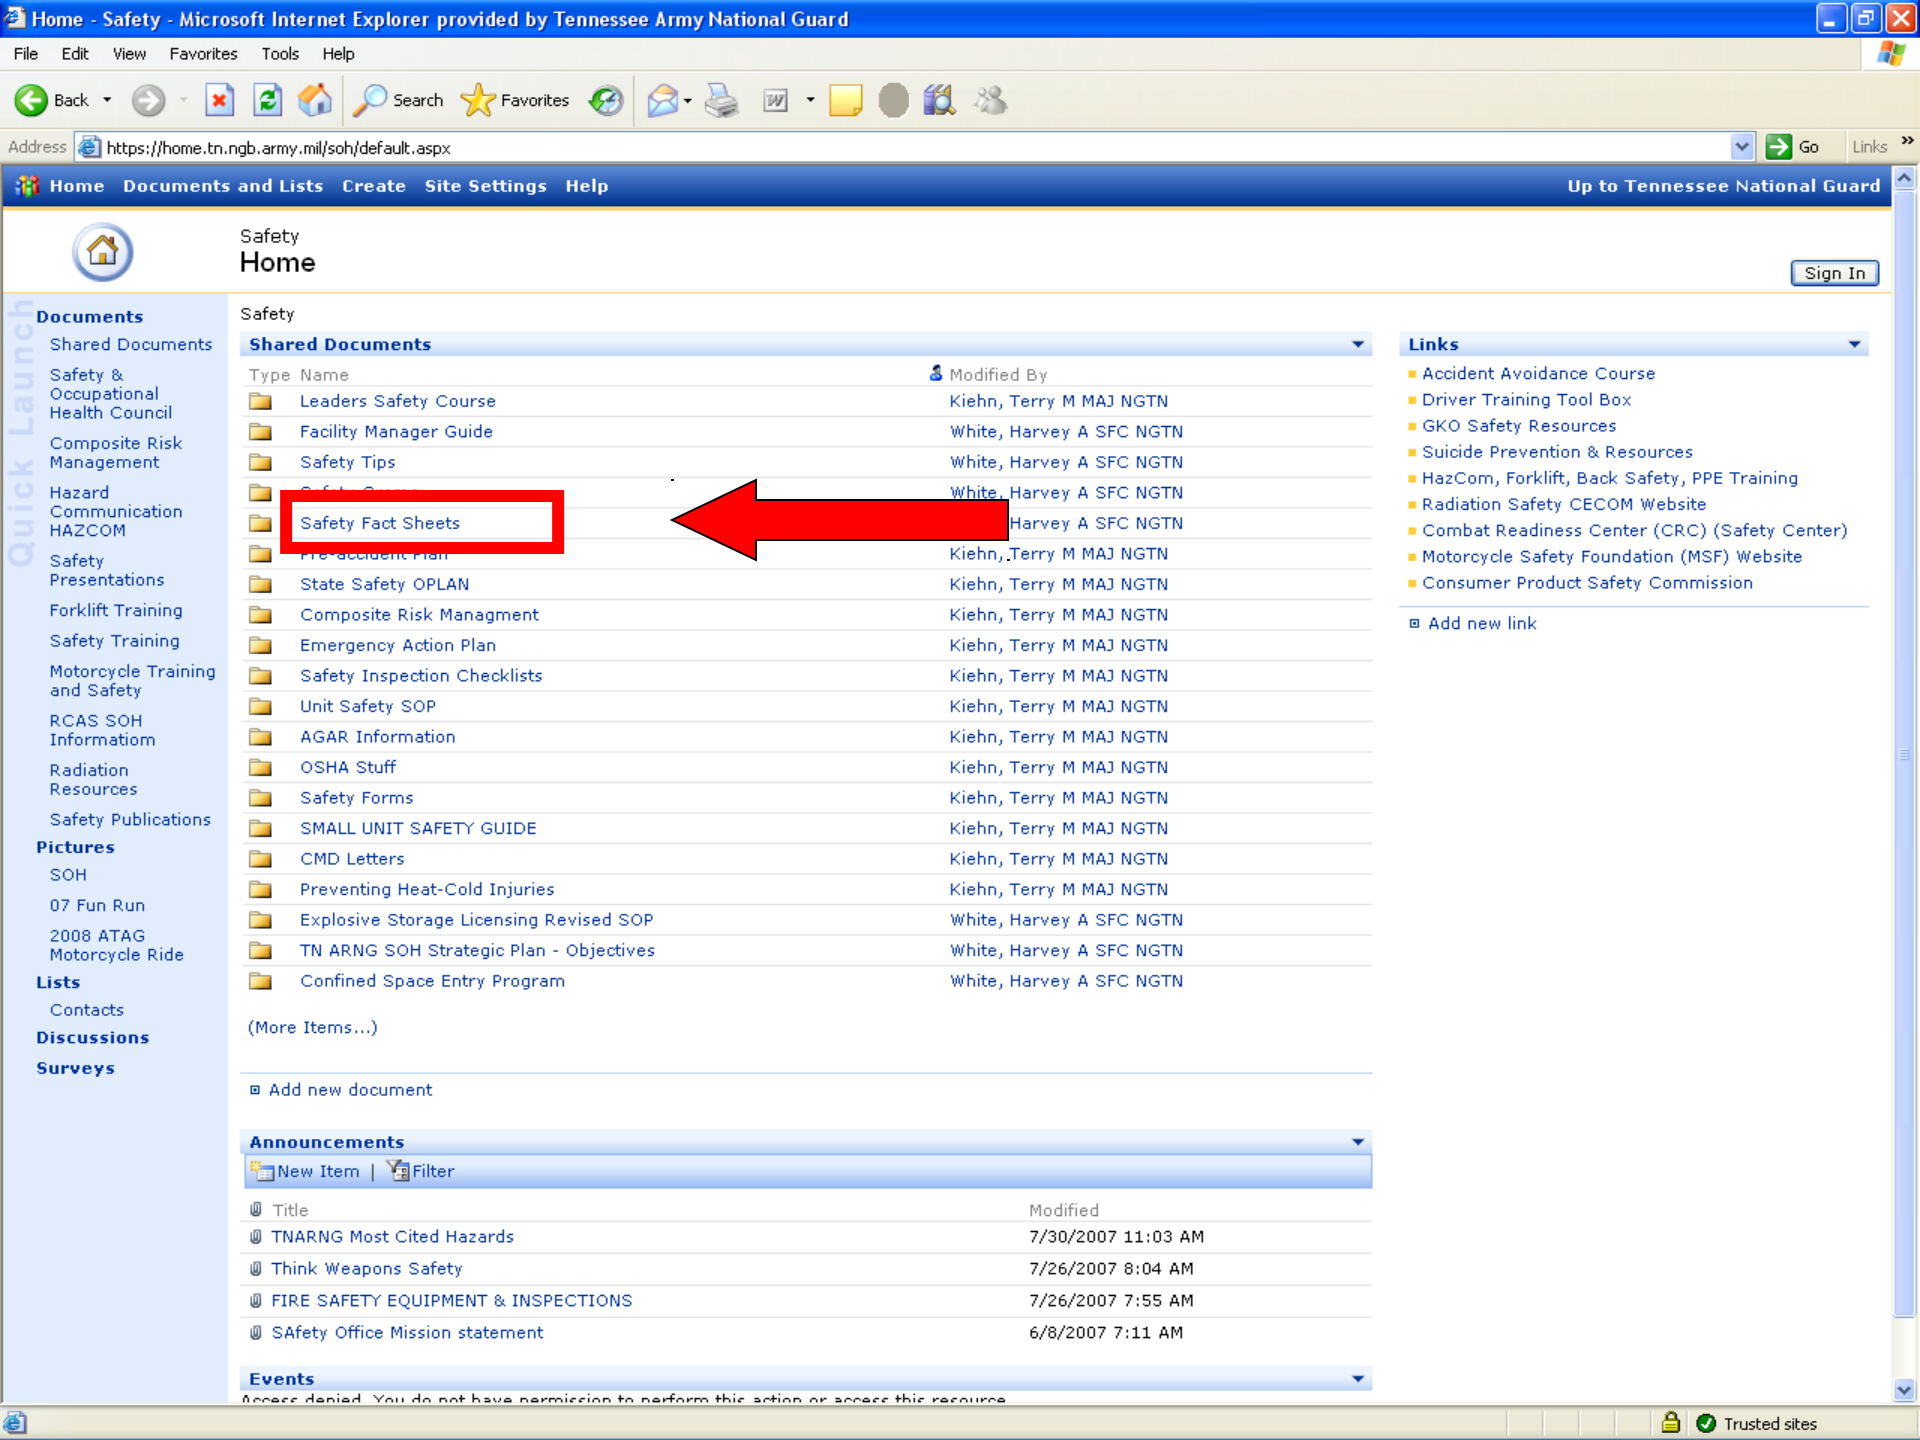

Home - Safety - Tennessee Army National Guard

File Edit View Favorites Tools Help

Back Forward Stop Home Search Favorites

Address https://home.tn.ngb.army.mil/soh/default.aspx Go Links

Home Documents and Lists Create Site Settings Help

Up to Tennessee National Guard

Safety Home

Sign In

Documents

Shared Documents

Safety & Occupational Health Council

Composite Risk Management

Hazard Communication HAZCOM

Safety Presentations

Forklift Training

Safety Training

Motorcycle Training and Safety

RCAS SOH Information

Radiation Resources

Safety Publications

Pictures

SOH

07 Fun Run

2008 ATAG Motorcycle Ride

Lists

Contacts

Discussions

Surveys

Safety

Safety Home

Safety

Shared Documents

Type	Name	Modified By
Folder	Leaders Safety Course	Kiehn, Terry M MAJ NGTN
Folder	Facility Manager Guide	White, Harvey A SFC NGTN
Folder	Safety Tips	White, Harvey A SFC NGTN
Folder	Safety Fact Sheets	White, Harvey A SFC NGTN
Folder	Fire Accident Plan	Harvey A SFC NGTN
Folder	State Safety OPLAN	Kiehn, Terry M MAJ NGTN
Folder	Composite Risk Management	Kiehn, Terry M MAJ NGTN
Folder	Emergency Action Plan	Kiehn, Terry M MAJ NGTN
Folder	Safety Inspection Checklists	Kiehn, Terry M MAJ NGTN
Folder	Unit Safety SOP	Kiehn, Terry M MAJ NGTN
Folder	AGAR Information	Kiehn, Terry M MAJ NGTN
Folder	OSHA Stuff	Kiehn, Terry M MAJ NGTN
Folder	Safety Forms	Kiehn, Terry M MAJ NGTN
Folder	SMALL UNIT SAFETY GUIDE	Kiehn, Terry M MAJ NGTN
Folder	CMD Letters	Kiehn, Terry M MAJ NGTN
Folder	Preventing Heat-Cold Injuries	Kiehn, Terry M MAJ NGTN
Folder	Explosive Storage Licensing Revised SOP	White, Harvey A SFC NGTN
Folder	TN ARNG SOH Strategic Plan - Objectives	White, Harvey A SFC NGTN
Folder	Confined Space Entry Program	White, Harvey A SFC NGTN

(More Items...)

Add new document

Announcements

New Item | Filter

Title	Modified
TNARNG Most Cited Hazards	7/30/2007 11:03 AM
Think Weapons Safety	7/26/2007 8:04 AM
FIRE SAFETY EQUIPMENT & INSPECTIONS	7/26/2007 7:55 AM
Safety Office Mission statement	6/8/2007 7:11 AM

Events

Links

- Accident Avoidance Course
- Driver Training Tool Box
- GKO Safety Resources
- Suicide Prevention & Resources
- HazCom, Forklift, Back Safety, PPE Training
- Radiation Safety CECOM Website
- Combat Readiness Center (CRC) (Safety Center)
- Motorcycle Safety Foundation (MSF) Website
- Consumer Product Safety Commission

Add new link

Access denied. You do not have permission to perform this action or access this resource.

Trusted sites




Fact Sheet

Developed by Safety Office, TNARNG, Nashville, TN

Portable Fire Extinguishers

- The TNARNG provides portable fire extinguishers for your use in extinguishing small fires when the action can be done safely.
- **Proper selection.** You must know the proper type of extinguisher to use on a specific fire. The main classes of fire extinguishers are:
 -  – Class  - general combustibles such as wood or paper
 -  – Class  - flammable liquids and gas fires
 -  – Class  - electrical fires
 -  – Class  - flammable metals
 -  – Class  - kitchen (grease) fires
- **Use.** When operating an extinguisher, remember PASS (Pull, Aim, Squeeze, Sweep):
 - Pull the pin from the handle
 - Aim the extinguisher nozzle at the base of the fire
 - Squeeze the handle to begin the flow of extinguishing agents
 - Sweep the nozzle slowly from side to side
- **Inspection, Maintenance, & Testing.**
 - External visual inspections are conducted monthly and documented on the attached tag
 - Annual maintenance checks are conducted by a license Fire Extinguisher Company
 - Units are hydrostatically tested by a license Fire Extinguisher Company



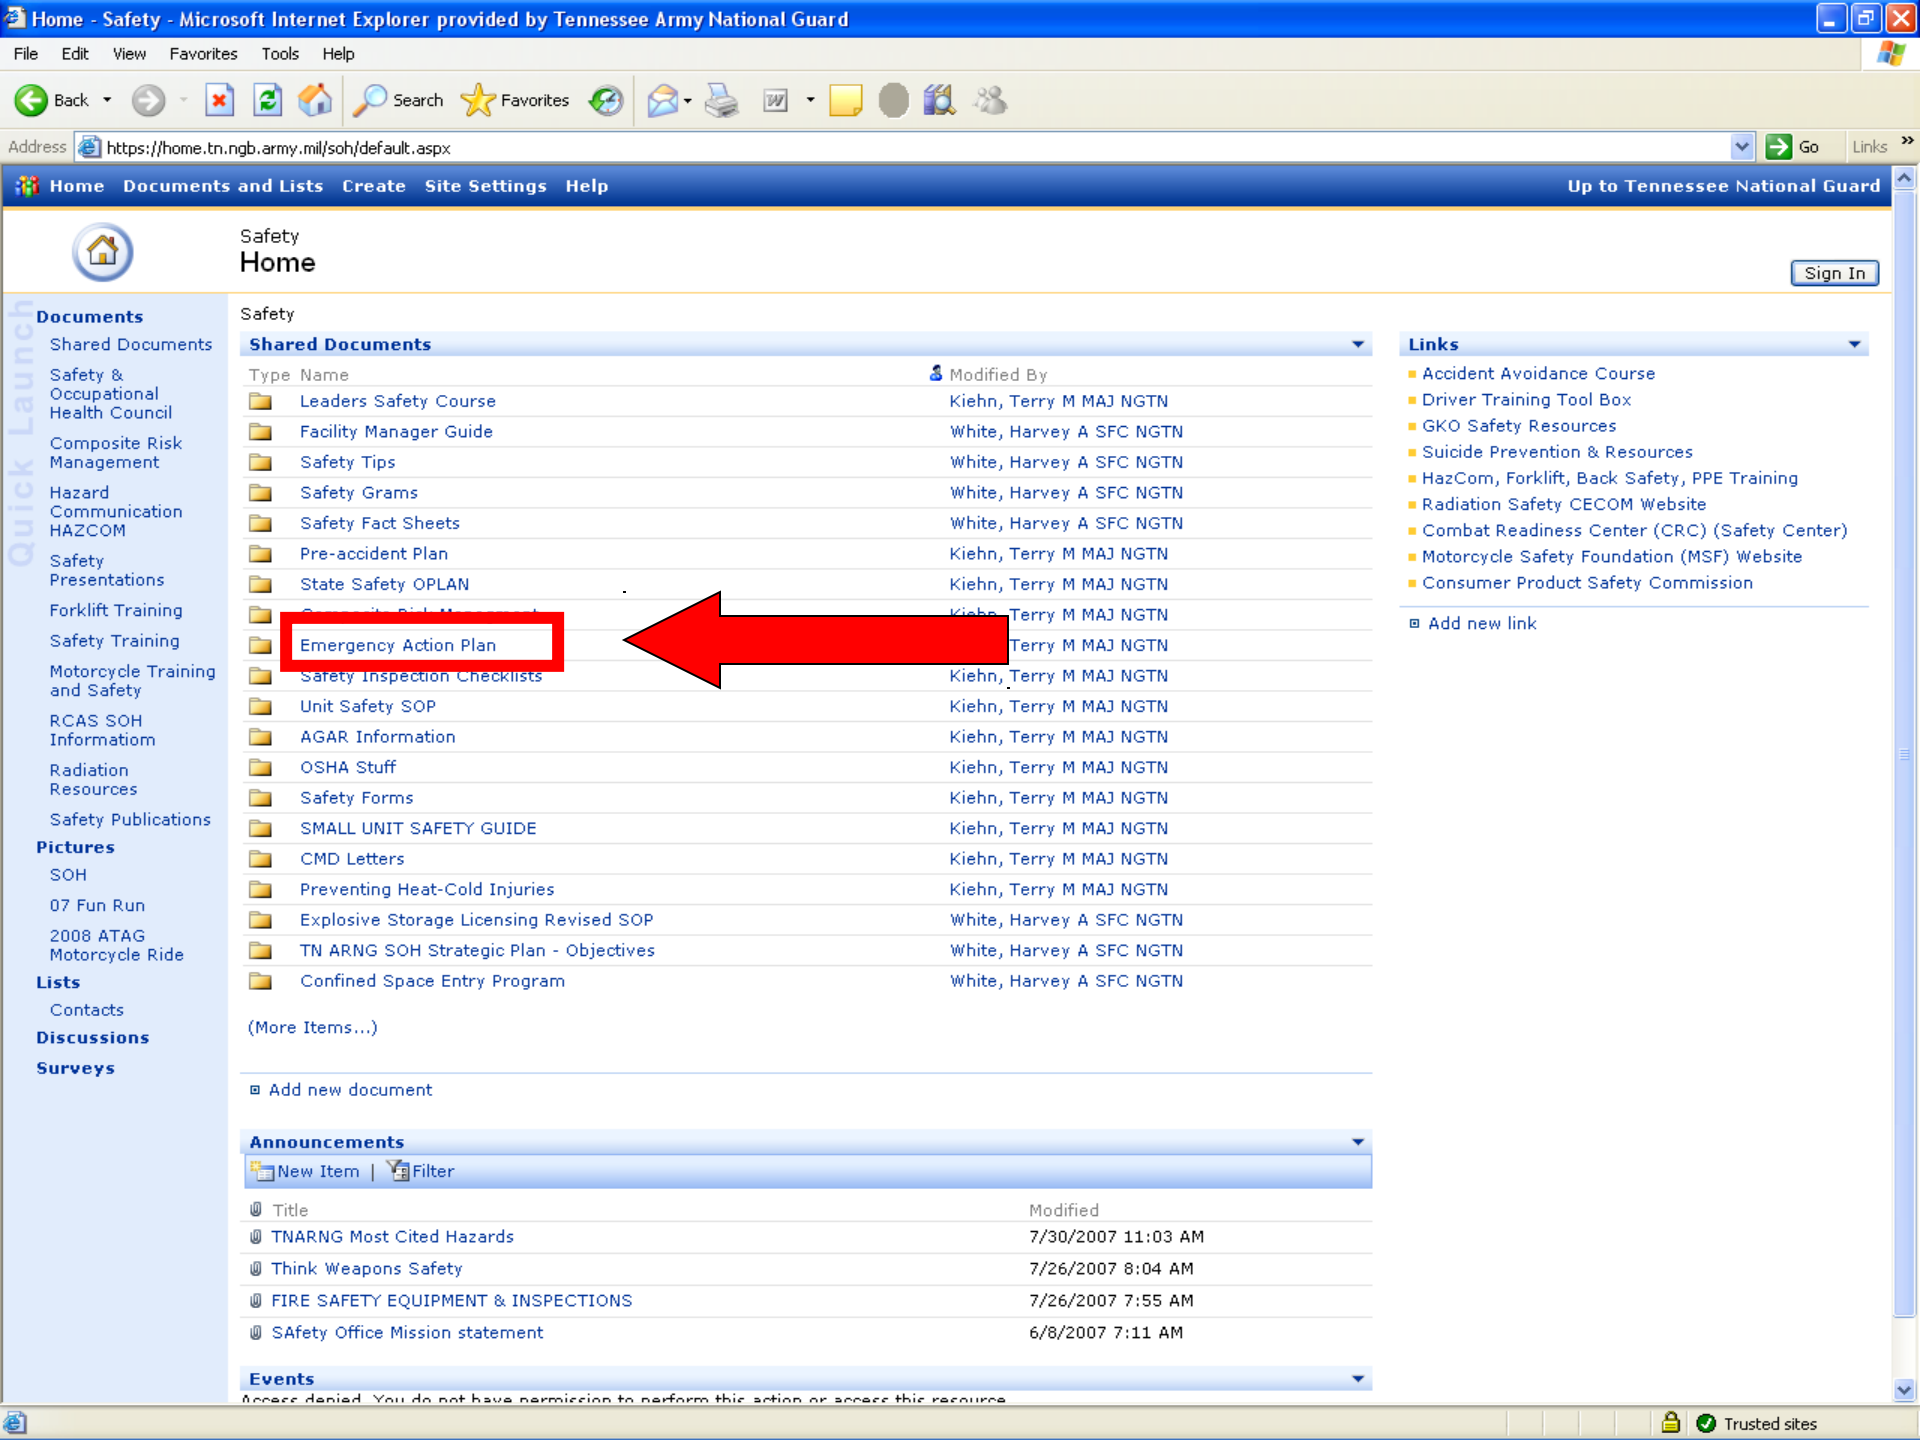

Home - Safety - Tennessee Internet Explorer provided by Tennessee Army National Guard

File Edit View Favorites Tools Help

Back

Forward

Stop

Home

Search

Favorites

Address

https://home.tn.ngb.army.mil/soh/default.aspx

Go

Links

Home Documents and Lists Create Site Settings Help

Up to Tennessee National Guard

Safety Home

Sign In

Documents

Shared Documents

Safety & Occupational Health Council

Composite Risk Management

Hazard Communication HAZCOM

Safety Presentations

Forklift Training

Safety Training

Motorcycle Training and Safety

RCAS SOH Information

Radiation Resources

Safety Publications

Pictures

SOH

07 Fun Run

2008 ATAG Motorcycle Ride

Lists

Contacts

Discussions

Surveys

Safety

Safety Home

Shared Documents

Type	Name	Modified By
Folder	Leaders Safety Course	Kiehn, Terry M MAJ NGTN
Folder	Facility Manager Guide	White, Harvey A SFC NGTN
Folder	Safety Tips	White, Harvey A SFC NGTN
Folder	Safety Grams	White, Harvey A SFC NGTN
Folder	Safety Fact Sheets	White, Harvey A SFC NGTN
Folder	Pre-accident Plan	Kiehn, Terry M MAJ NGTN
Folder	State Safety OPLAN	Kiehn, Terry M MAJ NGTN
Folder	Emergency Action Plan	Kiehn, Terry M MAJ NGTN
Folder	Safety Inspection Checklists	Kiehn, Terry M MAJ NGTN
Folder	Unit Safety SOP	Kiehn, Terry M MAJ NGTN
Folder	AGAR Information	Kiehn, Terry M MAJ NGTN
Folder	OSHA Stuff	Kiehn, Terry M MAJ NGTN
Folder	Safety Forms	Kiehn, Terry M MAJ NGTN
Folder	SMALL UNIT SAFETY GUIDE	Kiehn, Terry M MAJ NGTN
Folder	CMD Letters	Kiehn, Terry M MAJ NGTN
Folder	Preventing Heat-Cold Injuries	Kiehn, Terry M MAJ NGTN
Folder	Explosive Storage Licensing Revised SOP	White, Harvey A SFC NGTN
Folder	TN ARNG SOH Strategic Plan - Objectives	White, Harvey A SFC NGTN
Folder	Confined Space Entry Program	White, Harvey A SFC NGTN

(More Items...)

Add new document

Announcements

New Item | Filter

Title	Modified
TNARNG Most Cited Hazards	7/30/2007 11:03 AM
Think Weapons Safety	7/26/2007 8:04 AM
FIRE SAFETY EQUIPMENT & INSPECTIONS	7/26/2007 7:55 AM
Safety Office Mission statement	6/8/2007 7:11 AM

Events

Links

Accident Avoidance Course

Driver Training Tool Box

GKO Safety Resources

Suicide Prevention & Resources

HazCom, Forklift, Back Safety, PPE Training

Radiation Safety CECOM Website

Combat Readiness Center (CRC) (Safety Center)

Motorcycle Safety Foundation (MSF) Website

Consumer Product Safety Commission

Add new link

Access denied. You do not have permission to perform this action or access this resource.

Trusted sites

EMERGENCY ACTION PLAN

In Case of Fire R.A.C.E. & P.A.S.S

1.	Activate the fire alarm	Use any means to immediately notify occupants of fire
2.	Call Fire Department 911	Report location, what is burning, and if any personnel are in danger or injured. Remain a safe distance from the scene; await instructions and the arrival of emergency personnel.
3.	Alert occupants and evacuate the building/facility	Use labeled exits - proceed to the muster area and section OIC's conduct a headcount. Stay out of the building/facility until cleared to go back in.
4.	Close all doors	Attempt to close doors only if the fire is small and contained. If the fire is not small or contained, all personnel must leave the building- do not attempt to unplug equipment or close doors!
5.	Extinguish the fire	Attempt to extinguish the fire only if the fire is small and contained. Do not endanger yourself or others in this attempt.


Other Emergencies

1.	Activate the pre-accident plan	Activate the unit or facility pre-accident plan by the most expeditious means possible.
2.	EMERGENCY 911	Report location, nature of emergency, and if any personnel who are in danger or injured. Remain a safe distance from the scene; await instructions and the arrival of emergency personnel.
3.	Alert occupants and evacuate the building/facility/area	As appropriate. Use labeled exits - proceed to the muster area and Section OIC/NCOIC's conduct a headcount. Stay out of the area until cleared to go back in.
4.	Allow medical personnel and first responders access	Do not interfere with first responders. The first priority is saving lives!
5.	Secure classified materials, ammunition, and weapons	Attempt to secure classified information, ammunition, and weapons only if it does not endanger personnel.
6.	Post guards to prevent access by unauthorized personnel if needed	Allow law enforcement access to assist in security and traffic flow.
7.	Remain in contact	Remain near the telephone and keep the line open if possible.
8.	Direct all questions to CDR/PAO	Do not discuss with anyone except key personnel identified within 1 st Squadron and then only on a need-to-know basis.

When a Tornado Warning is issued go to a hallway on the ground floor where there are no windows

EMERGENCY ACTION PLAN

R.A.C.E = Rescue-Activate-Contain-Extinguish/Evacuate P.A.S.S. = Pull-Aim-Squeeze-Sweep

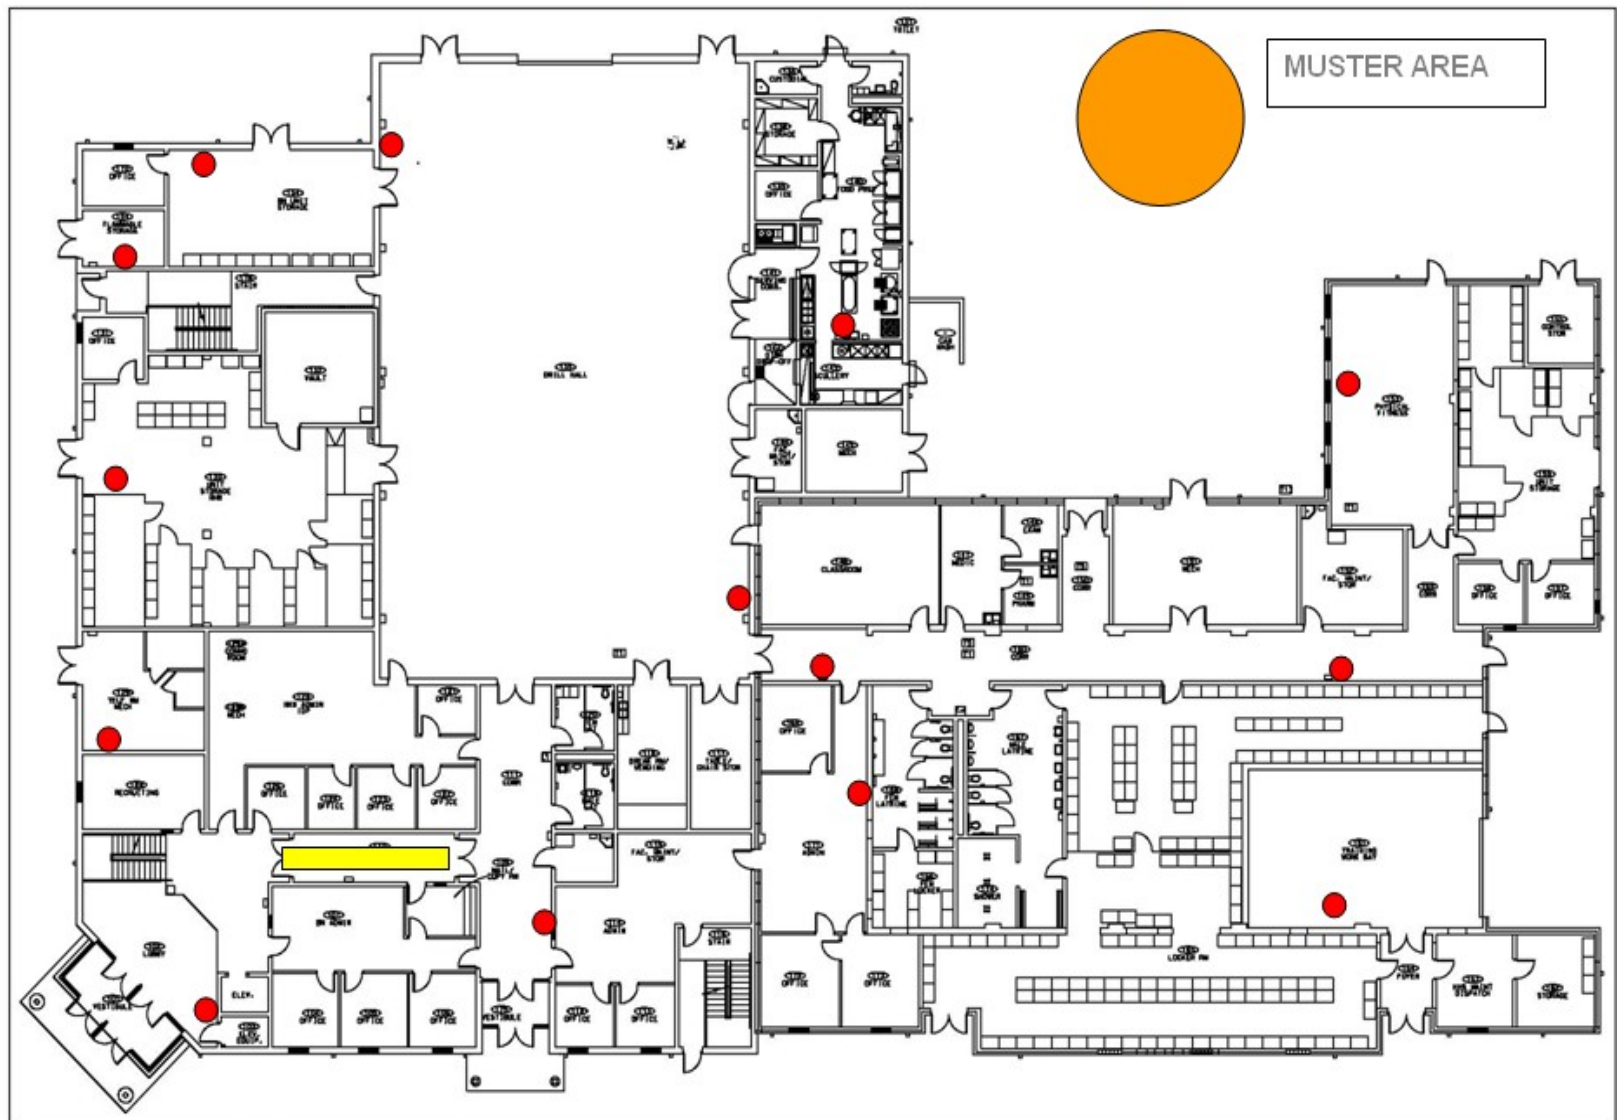


D:\HENDERSON2D1.dgn 7/25/2006 4:04:40 PM



Fire Extinguisher Location



Tornado Safe Area with doors closed

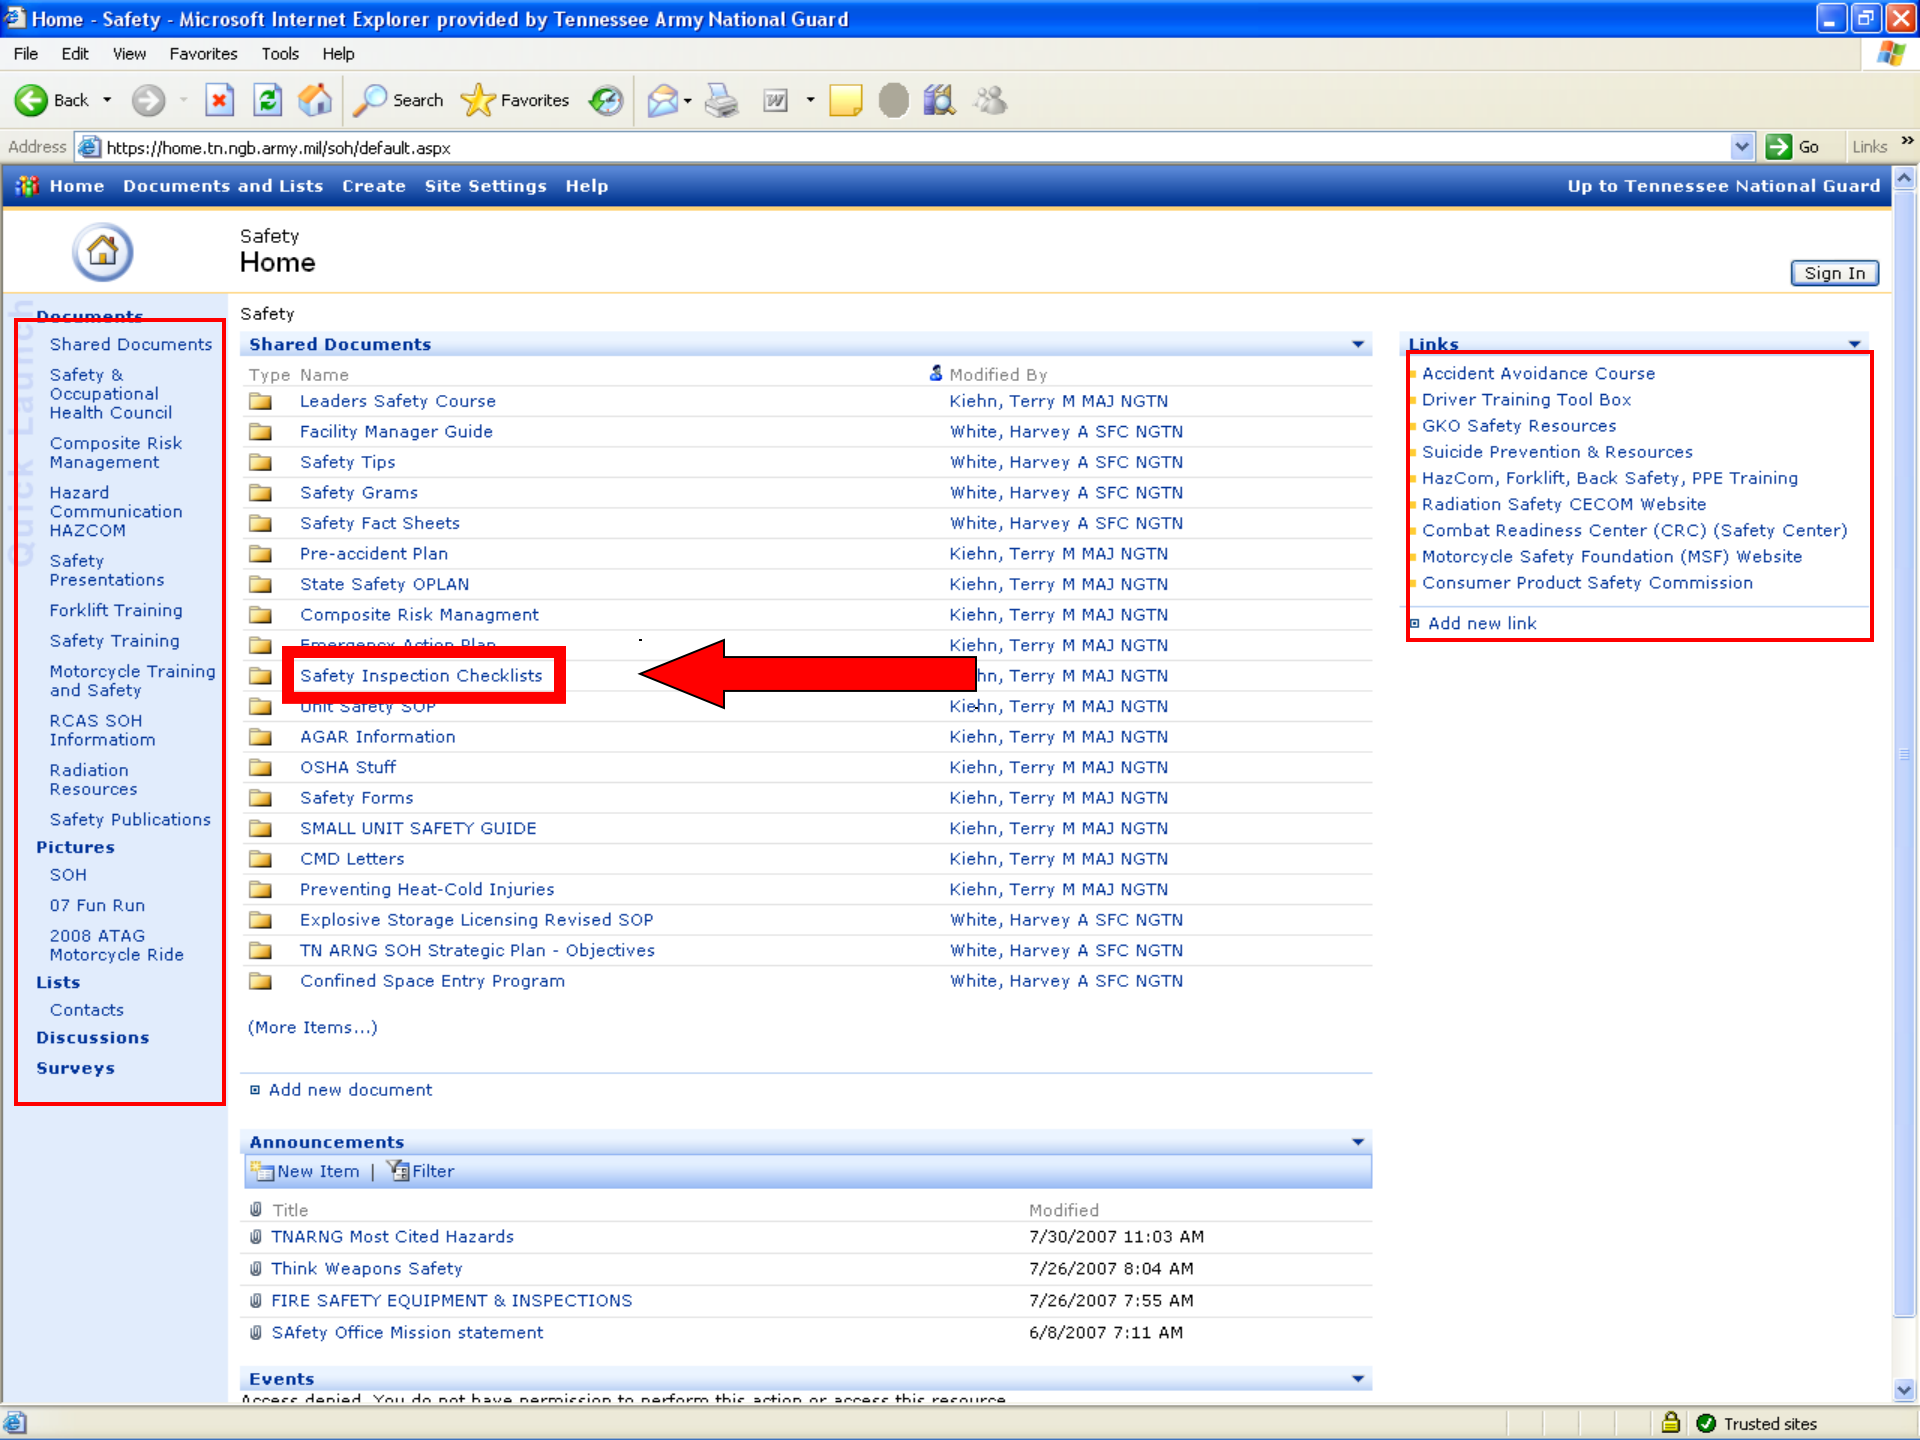

Safety Home

Sign In

Documents

- Shared Documents
- Safety & Occupational Health Council
- Composite Risk Management
- Hazard Communication HAZCOM
- Safety Presentations
- Forklift Training
- Safety Training
- Motorcycle Training and Safety
- RCAS SOH Information
- Radiation Resources
- Safety Publications
- Pictures
- SOH
- 07 Fun Run
- 2008 ATAG Motorcycle Ride
- Lists
- Contacts
- Discussions
- Surveys

Safety

Shared Documents

Type	Name	Modified By
Folder	Leaders Safety Course	Kiehn, Terry M MAJ NGTN
Folder	Facility Manager Guide	White, Harvey A SFC NGTN
Folder	Safety Tips	White, Harvey A SFC NGTN
Folder	Safety Grams	White, Harvey A SFC NGTN
Folder	Safety Fact Sheets	White, Harvey A SFC NGTN
Folder	Pre-accident Plan	Kiehn, Terry M MAJ NGTN
Folder	State Safety OPLAN	Kiehn, Terry M MAJ NGTN
Folder	Composite Risk Management	Kiehn, Terry M MAJ NGTN
Folder	Emergency Action Plan	Kiehn, Terry M MAJ NGTN
Folder	Safety Inspection Checklists	Kiehn, Terry M MAJ NGTN
Folder	Unit Safety SOP	Kiehn, Terry M MAJ NGTN
Folder	AGAR Information	Kiehn, Terry M MAJ NGTN
Folder	OSHA Stuff	Kiehn, Terry M MAJ NGTN
Folder	Safety Forms	Kiehn, Terry M MAJ NGTN
Folder	SMALL UNIT SAFETY GUIDE	Kiehn, Terry M MAJ NGTN
Folder	CMD Letters	Kiehn, Terry M MAJ NGTN
Folder	Preventing Heat-Cold Injuries	Kiehn, Terry M MAJ NGTN
Folder	Explosive Storage Licensing Revised SOP	White, Harvey A SFC NGTN
Folder	TN ARNG SOH Strategic Plan - Objectives	White, Harvey A SFC NGTN
Folder	Confined Space Entry Program	White, Harvey A SFC NGTN

(More Items...)

Add new document

Announcements

New Item | Filter


Title	Modified
TNARNG Most Cited Hazards	7/30/2007 11:03 AM
Think Weapons Safety	7/26/2007 8:04 AM
FIRE SAFETY EQUIPMENT & INSPECTIONS	7/26/2007 7:55 AM
Safety Office Mission statement	6/8/2007 7:11 AM

Events

Access denied. You do not have permission to perform this action or access this resource.

Links

- Accident Avoidance Course
- Driver Training Tool Box
- GKO Safety Resources
- Suicide Prevention & Resources
- HazCom, Forklift, Back Safety, PPE Training
- Radiation Safety CECOM Website
- Combat Readiness Center (CRC) (Safety Center)
- Motorcycle Safety Foundation (MSF) Website
- Consumer Product Safety Commission
- Add new link

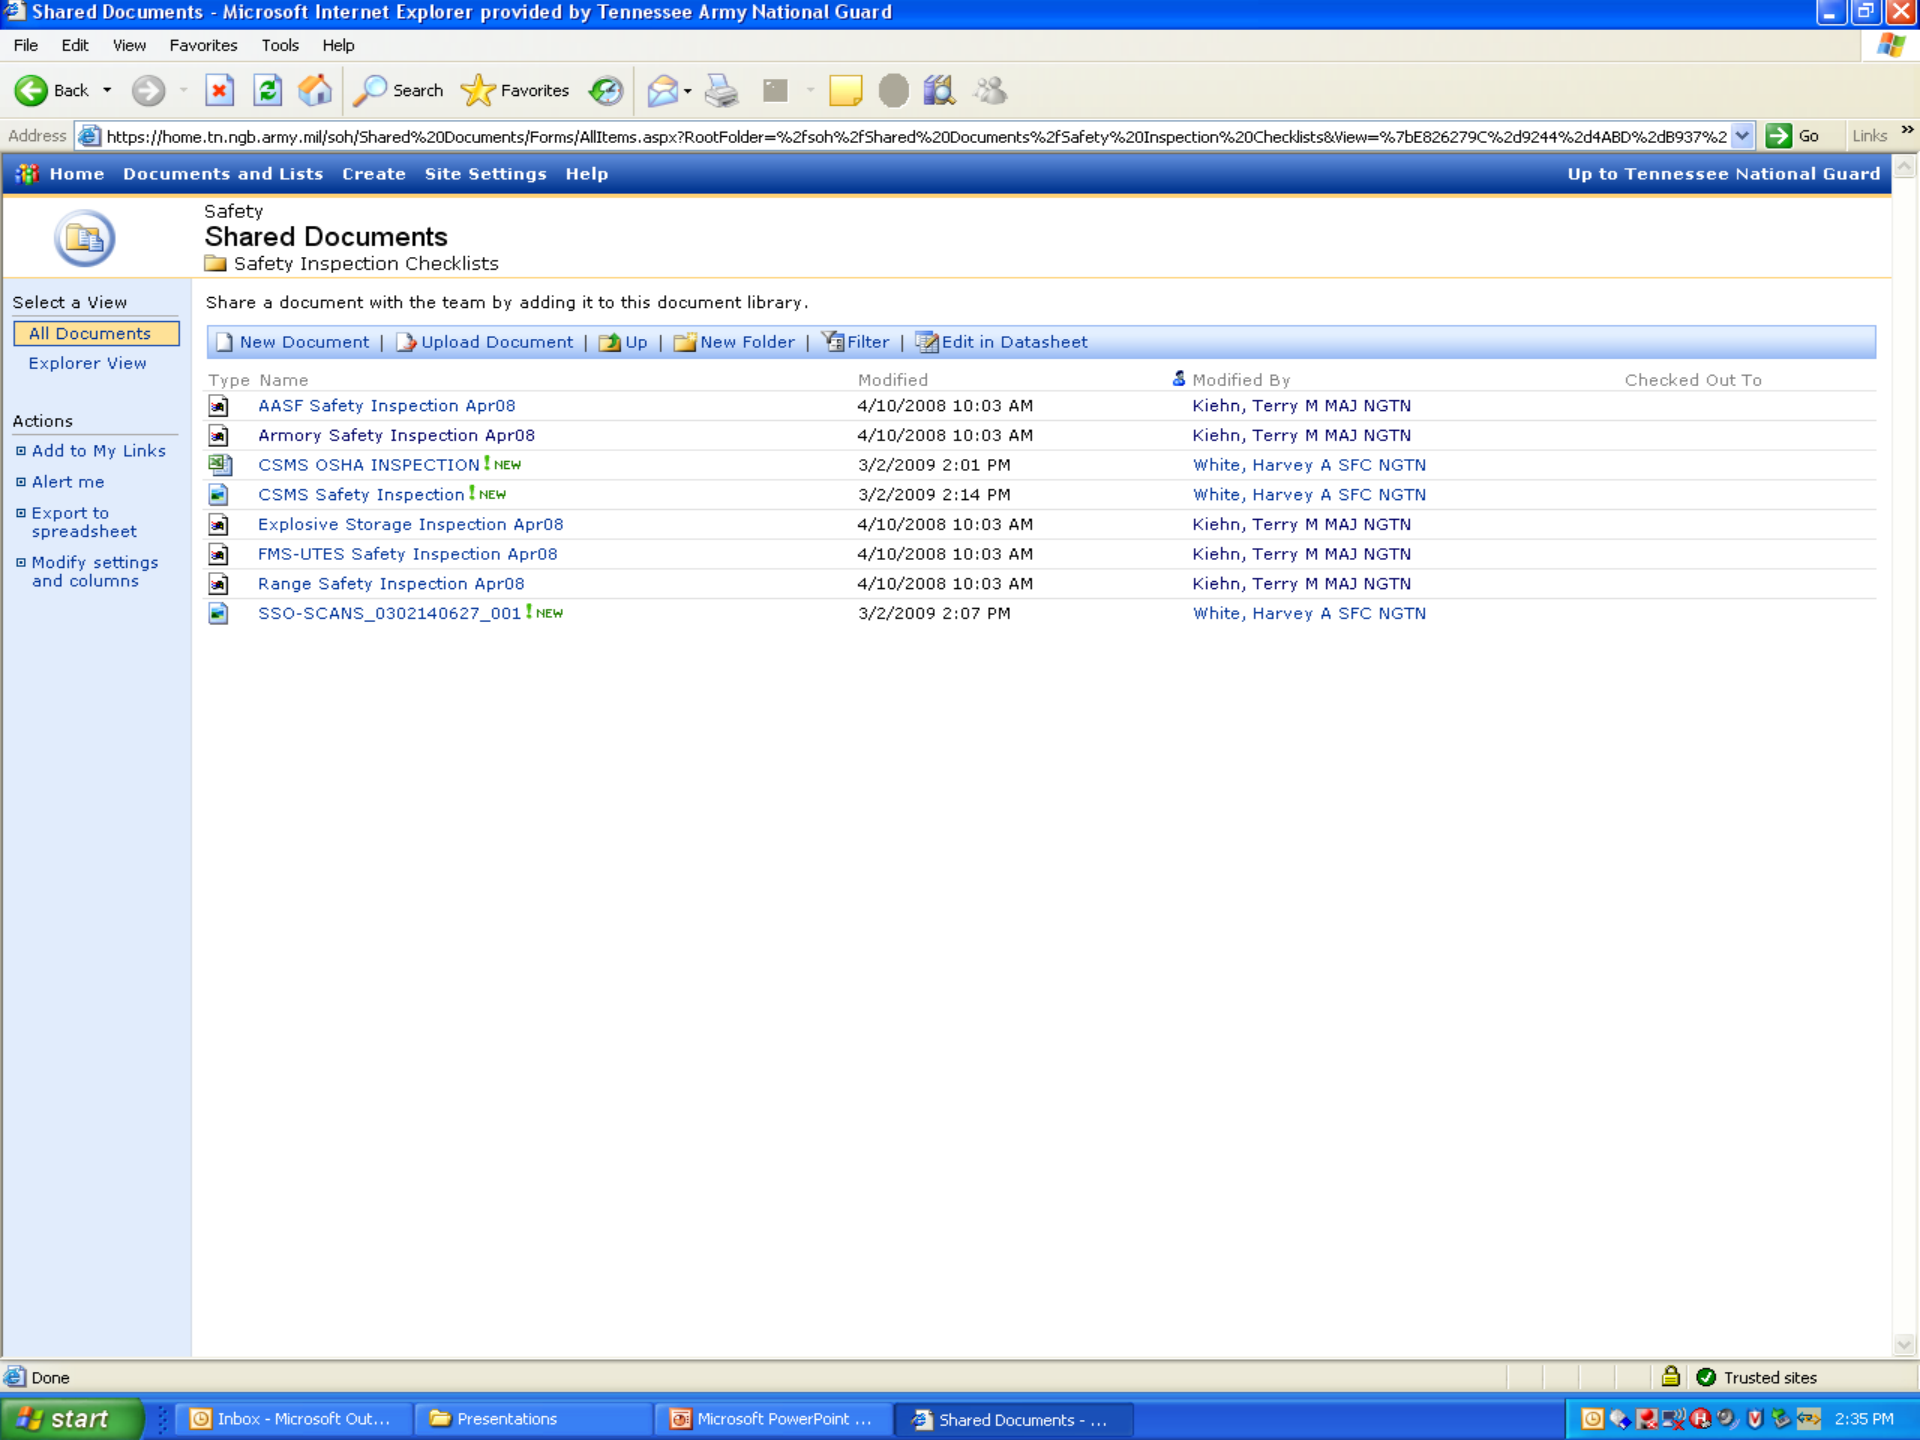

ARMORY SAFETY INSPECTION CHECKLIST		3/08	
UNIT:			
UNIT UIC:			
DATE:			
INSPECTED BY:			
UNIT SAFETY OFFICER/NCO:			
Email Commanders		1SGT	
1 ADMINISTRATION		RAC	YES NO
Has a full time Safety Officer/NCO been appointed in writing or a M-day Safety Officer/NCO been appointed. BN level or higher must be an Officer. Co level must be E6 or higher. AR 385-10 Para 2-7 (g) 1-3			
Have all managers and supervisors received formal CSHA training? See AR 385-10 Para 10-8			
Has the appointed Safety Officer/NCO completed the ADSCO Course and does he/she conduct safety training in the activity and is it documented? (AR385-10 para 10-6)			
Has a safety and occupational health council (SOHC) been appointed in writing? AR 385-10, 2-1x			
Are material safety data sheets (MSDS), for each hazardous chemical, maintained and readily accessible in the work place for all personnel to view? 1910.1200(g)(5)			
Has initial hazard communications training been conducted for all personnel? Has training been documented? The record of this training must be kept for the duration of employment / enlistment plus 30 years. 1910.1200(h)(1)			
Is annual refresher Hazard Communication training conducted and has it been documented? 1910.1200(h)(1)			
Does each activity maintain an up to date inventory of all hazardous chemicals in the workplace? Have all personnel reviewed the hazardous chemical list annually, signed and dated the roster? New personnel will review the hazardous chemical list, and sign and date the roster prior to performing any task within the workplace 1910.1200(i)(1)(i)			
Have the newly assigned personnel received a safety orientation briefing (training) initially and annually thereafter on safety and health programs of the organization and has the training / briefing been documented? AR 385-10 2-1h			
Does the facility have a Fire Prevention Plan?			
Does the Facility have a published Emergency action Plan?			
Is the Facility Emergency Action Plan, and Fire Prevention Plan tested annually			
2 PERSONAL PROTECTIVE EQUIPMENT		RAC	YES NO
Are first aid kits near proximity in the workplace with adequate supplies available, periodically inspected and replenished as needed. 1910.151(b)			
3 GENERAL ENVIRONMENTAL CONTROLS		RAC	YES NO
Are all sweepings, solid or liquid wastes, refuse, and garbage removed in such a manner and as often as necessary so as to avoid a menace to health? 1910.22(a)(1)			
Are washing facilities maintained in a sanitary condition? 1910.141(d)(1)			
Are foods or beverages stored in rooms or in an area exposed to toxic or caustic materials? 1910.141(g)(4)			
Are air filters changed and air vents cleaned periodically on heating, ventilation, and air conditioning systems to reduce			
4 WALKING AND WORKING SURFACES		RAC	YES NO
Are all stairs and passageways kept in good repair at all times with no obstructions across or in the aisles? 1910.22(b)(1)			
Are passageways, storerooms, and service rooms kept in a clean, orderly and sanitary condition? 1910.22(a)(1)			
Are floor load limits posted for occupancy and/or load limits? 1910.22(d)(1)			
5 MEANS OF EGRESS		RAC	YES NO
Are all exits prohibited from being locked or fastened and kept free and unobstructed when the building is occupied? 1910.36(a)			
Is each building exit marked with a visible exit sign with letters not less than six inches high and 3/4 inches wide and giving illumination by a reliable light source of a value of not less than five (5) foot candles on the illuminating surface? 1910.37(a)(7)			
Is emergency lighting installed to provide illumination not less than one (1) foot candle throughout the means of egress for a period of 1/2 hours in the event of failure of the normal lighting? NFPA 1016-5.1.3			
Are furnishings, decorations, or other objects obstructing exits, access there to, egress there from, or visibility thereof? 1910.37(a)(3)			
Can all exits be reached without going through a kitchen, storeroom, rest room, closet, or similar space subject to being locked? 1910.37(a)(3)			
Are doors, as a required means of egress, equipped with panic hardware (quick release bar) in any area having an occupant load of 100 or more persons? NFPA 101, Para 12.2.2.2.2.3			
When exit doors are locked, can the door be unlocked from the inside without the use of a key, specific knowledge, or effort? NFPA 101, Para 7.2.1.5.2			
Can any door, passage or stairway be mistaken for an exit, which is neither an exit nor a way of exit, properly marked "NOT AN EXIT"? (In one story buildings where the exit is clearly visible, it is not necessary to mark doors to small closets). 1910.37(a)(5)			
There shall be no smoking or open flames in State or Federal buildings. 1900.1			


6 FIRE PROTECTION	RAC	YES	NO
Has the commander / supervisor appointed on orders a responsible person as their fire marshal? Has the fire marshal designated subordinate personnel in each building or facility as a building or unit fire warden? AR 420-90, 6-2a	4		
Has the commander / supervisor provided an educational program to familiarize all personnel with the general principles of fire extinguisher use and the hazards involved with incipient stage of fire fighting? Has the training been conducted upon initial employment / enlistment and annually thereafter? Is it documented? 1910.157(a)(1)	3		
Is each portable fire extinguisher (including vehicle fire extinguishers) visually inspected monthly and a record of the inspection maintained? 1910.157(a)(2)	3		
Is each portable fire extinguisher subjected to an annual maintenance check? Is a record of the inspection maintained and kept for one (1) year after the last entry or for the life of the shell, whichever is earlier? 1910.157(a)(3)	3		
Have fire extinguishers and hose assemblies been hydrostatically tested and have results, date of test, test pressure used, and the person or agency performing the test been recorded? 1910.157(a)(2)	3		
Are operational range exhaust hoods, with an exhaust fan, installed over kitchen ranges? NFPA 96 (1-3.1)	3		
Are grease filters installed in each kitchen range exhaust hood and maintained free of dirt, dust, and grease? NFPA 96 (4-1)	3		
Have installed fire alarms been tested in the buildings? 1910.37(e)	3		
7 FLAMMABLE AND COMBUSTIBLE	RAC	YES	NO
Are flammable and combustible liquids maintained in the immediate work area stored in CSHA approved storage cabinets?	2		
Are approved storage cabinets used to store flammable and combustible liquids labeled "FLAMMABLE - KEEP FIRE AWAY"? 1910.106(d)(3)(ii)	4		
Is there at least one clear aisle not less than three (3) feet wide maintained at all times in the inside storage rooms for storing flammable and combustible liquids? 1910.106(d)(4)(v)	4		
Is there a portable fire extinguisher located outside of, (inside or outside storage) but not more than 10 feet from the door opening into any room or building used for storage of flammable and combustible liquids? 1910.106(d)(7)(ii)(b)	3		
Are "open flames", "spark producing", and/or "smoking prohibited" signs posted in flammable and combustible liquids storage areas? 1910.106(d)(7)(ii)	2		
Are flammable and combustible liquids spills present that have not been promptly and properly cleaned up?	3		
Are there provisions to contain flammable and/or combustible liquids in the event of a spillage (the storage area shall be graded to divert possible spills away from buildings or other exposures (environment) or shall be surrounded by a curb at least six (6) inches high at or in the outside storage building? 1910.106(d)(8)(ii)	3		
A combustible waste must be stored in a covered metal container and emptied daily (Ref: NFPA 30 5-5.3.3)	2		
8 POL FACILITIES AND OPERATIONS	RAC	YES	NO
Are POL facilities marked "NO SMOKING" within fifty (50) feet? FM 10-67-1, CH2	3		
Are serviceable fire extinguishers available in the POL vehicle parking areas? FM 10-67-1, CH2	3		
Are dispensing units serviceable and free of fuel leaks? FM 10-67-1, CH2	3		
9 MATERIALS HANDLING AND STORAGE	RAC	YES	NO
Are storage areas kept free from accumulation of materials that constitute hazards from tripping, fire, explosion or pest harborage? 1910.176(c)	2		
Is vegetation controlled in and around outside storage areas? 1910.176(c)	3		
10 ELECTRICAL	RAC	YES	NO
Are live parts of electrical equipment, operating at 50 volts or more, guarded against accidental contact by being enclosed in approved cabinets or other approved enclosures? 1910.303(a)(2)(ii)	1		
Is a minimum working space provided in front of electrical service equipment and electrical control panels where there are live parts normally exposed (3 ft in front and a minimum headroom provided not less than 6 ft 3 in)? 1910.303(a)(1)(i)	4		
Does each electrical outlet box, pull box, junction box, and cabinet have an installed faceplate, cover, or canopy cover? Are unused openings in cabinets or boxes closed properly? 1910.305(b)(1)	2		
Are box covers, face plates, receptacles, or electrical plugs kept safe and unbroken? 1910.305(b)(2)	3		
Is water or moisture prevented from entering and accumulating within electrical cabinets, panel boards and junction boxes? 1910.305(b)	1		
Is motor operated equipment (i.e. hand held motor operated tools, portable hand lamps, refrigerators, air conditioners, water coolers, freezers, clothes washer / dryer, etc.) properly grounded with a three prong plug and cord (appliances protected by an approved system of double insulation need not be grounded)? 1910.304(f)(5)(iv)	3		
Are flexible cords and cables prohibited from use as a substitute for permanent wiring of a structure, and from being run through doorways, windows, similar openings, or holes in walls, ceilings, and floors? 1910.305(a)(1)(ii)(A)	3		
Are electrical boxes / conduit securely fastened? 1910.305(a)(1)(i)	3		
Are power cords on portable power tools and equipment free from cracks, cuts, or swelling? 1903.1	3		
Are outlets in damp/humid location properly grounded with a ground fault circuit interrupter. 1910.304(f)(5)(v)(C)(v)	4		
Relocatable Power Tap (RPT) is...Power strips daisy chained. 250CFR1910.303(b)(2)	2		

Safety

Inspections

- OSHA requires employers to provide a hazard free workplace
- Annual requirement
- 135 sites -100%



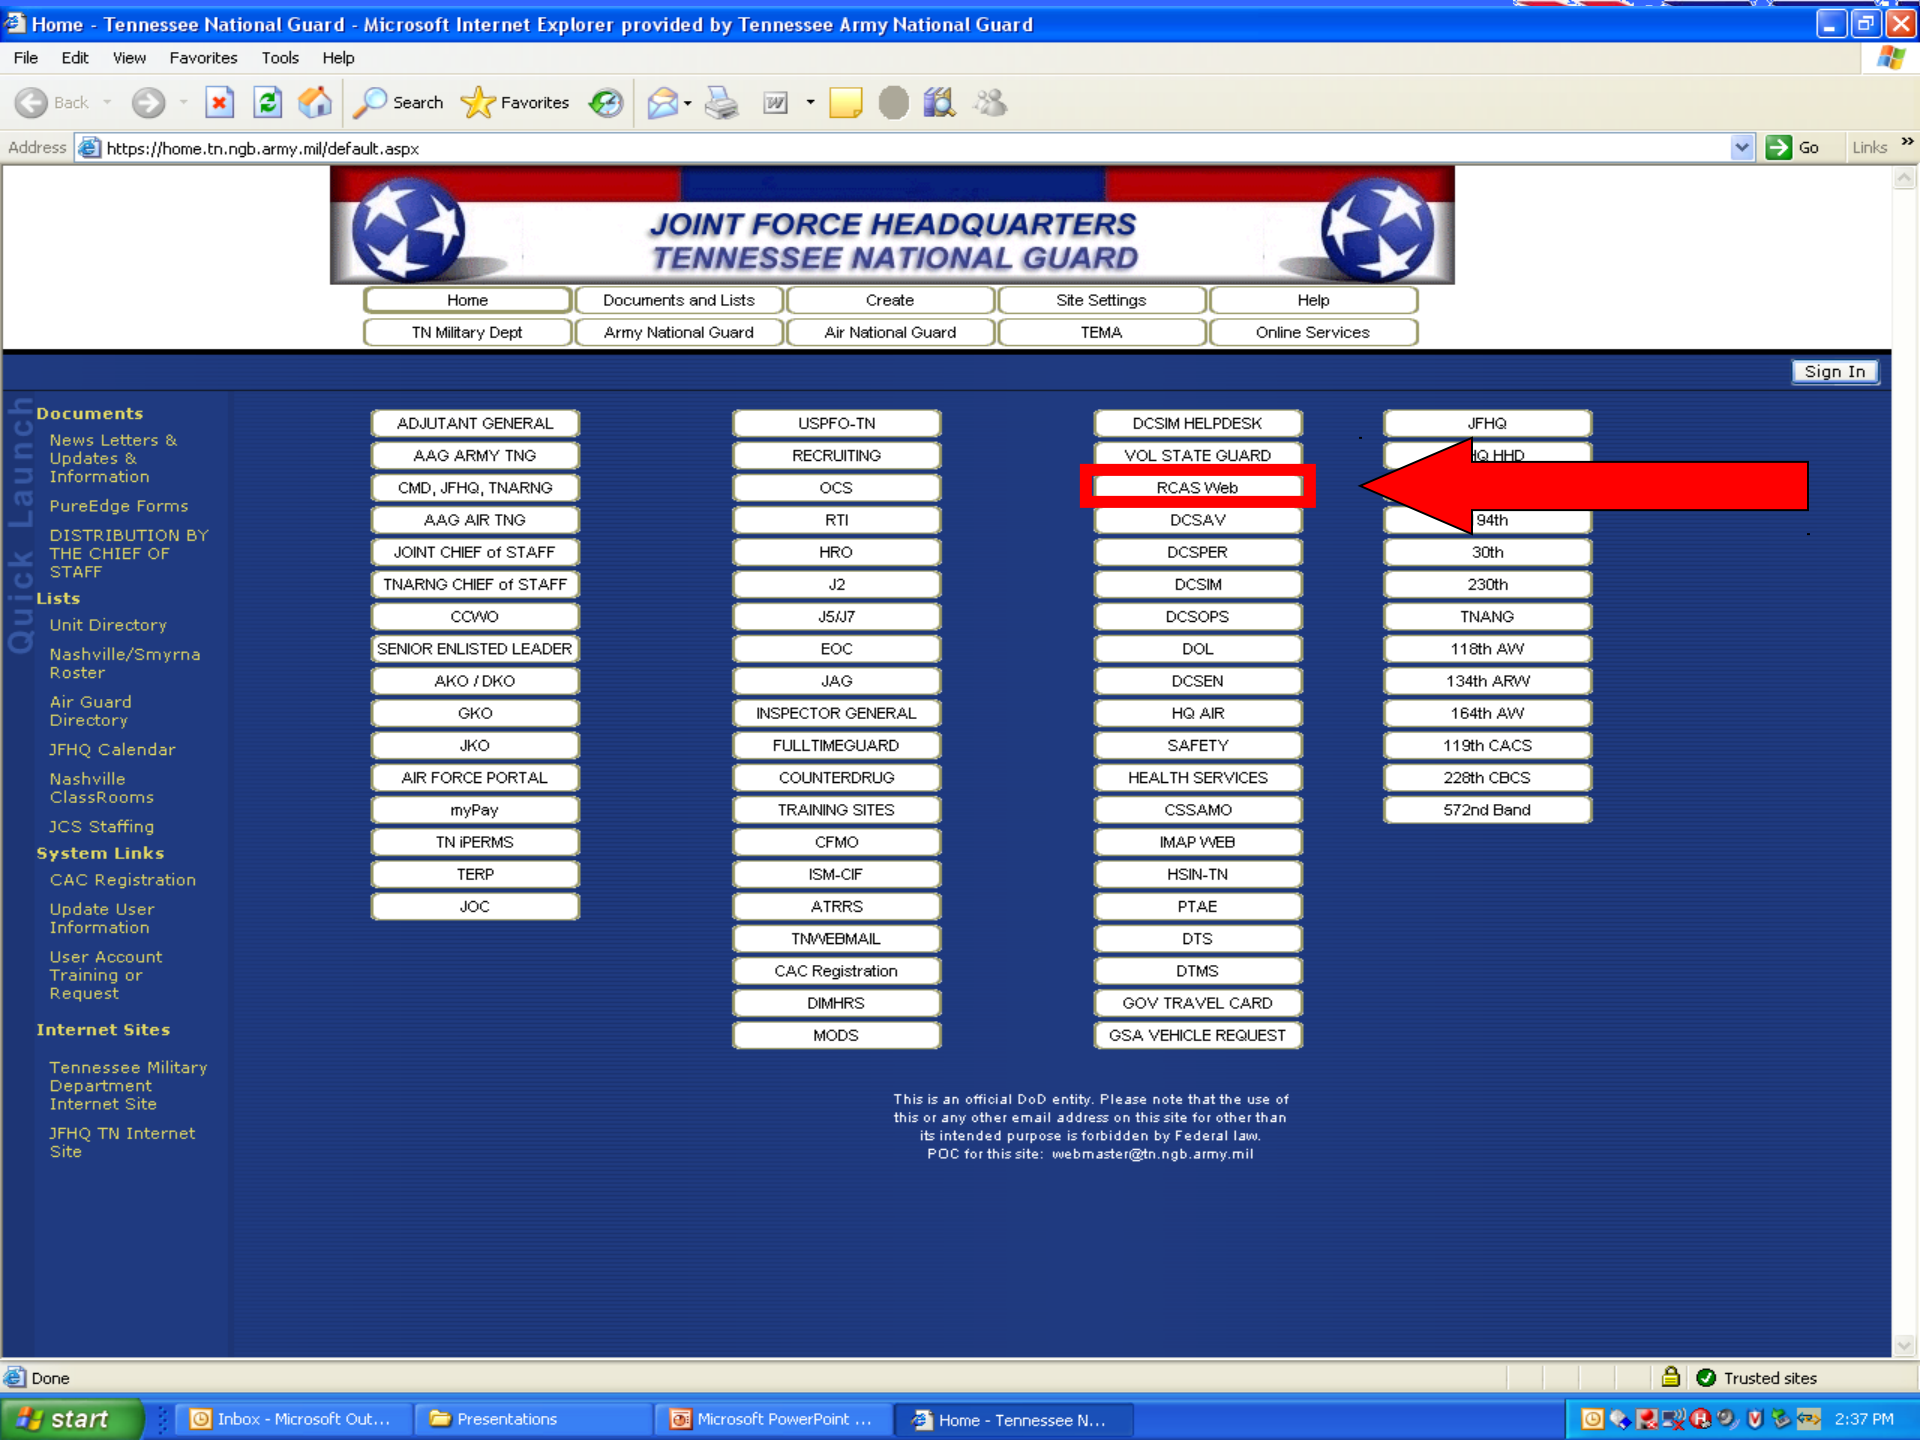

- Home Documents and Lists Create Site Settings Help
- TN Military Dept Army National Guard Air National Guard TEMA Online Services

Sign In

- Quick Launch**
- Documents**
- News Letters & Updates & Information
 - PureEdge Forms
 - DISTRIBUTION BY THE CHIEF OF STAFF
- Lists**
- Unit Directory
 - Nashville/Smyrna Roster
 - Air Guard Directory
 - JFHQ Calendar
 - Nashville ClassRooms
 - JCS Staffing


System Links


Internet Sites

- Tennessee Military Department Internet Site
- JFHQ TN Internet Site

- | | | | |
|------------------------|-------------------|---------------------|------------|
| ADJUTANT GENERAL | USPFO-TN | DCSIM HELPDESK | JFHQ |
| AAG ARMY TNG | RECRUITING | VOL STATE GUARD | HQ HHD |
| CMD, JFHQ, TNARNG | OCS | RCAS Web | 94th |
| AAG AIR TNG | RTI | DCSAV | 30th |
| JOINT CHIEF of STAFF | HRO | DCSPER | 230th |
| TNARNG CHIEF of STAFF | J2 | DCSIM | TNANG |
| CCWO | J5/J7 | DCSOPS | 118th AVW |
| SENIOR ENLISTED LEADER | EOC | DOL | 134th ARW |
| AKO / DKO | JAG | DCSEN | 164th AVW |
| GKO | INSPECTOR GENERAL | HQ AIR | 119th CACS |
| JKO | FULLTIMEGUARD | SAFETY | 228th CBCS |
| AIR FORCE PORTAL | COUNTERDRUG | HEALTH SERVICES | 572nd Band |
| myPay | TRAINING SITES | CSSAMO | |
| TN IPERMS | CFMO | IMAP WEB | |
| TERP | ISM-CIF | HSIN-TN | |
| JOC | ATRRS | PTAE | |
| | TNWEBMAIL | DTS | |
| | CAC Registration | DTMS | |
| | DIMHRS | GOV TRAVEL CARD | |
| | MODS | GSA VEHICLE REQUEST | |

This is an official DoD entity. Please note that the use of this or any other email address on this site for other than its intended purpose is forbidden by Federal law.
POC for this site: webmaster@tn.ngb.army.mil

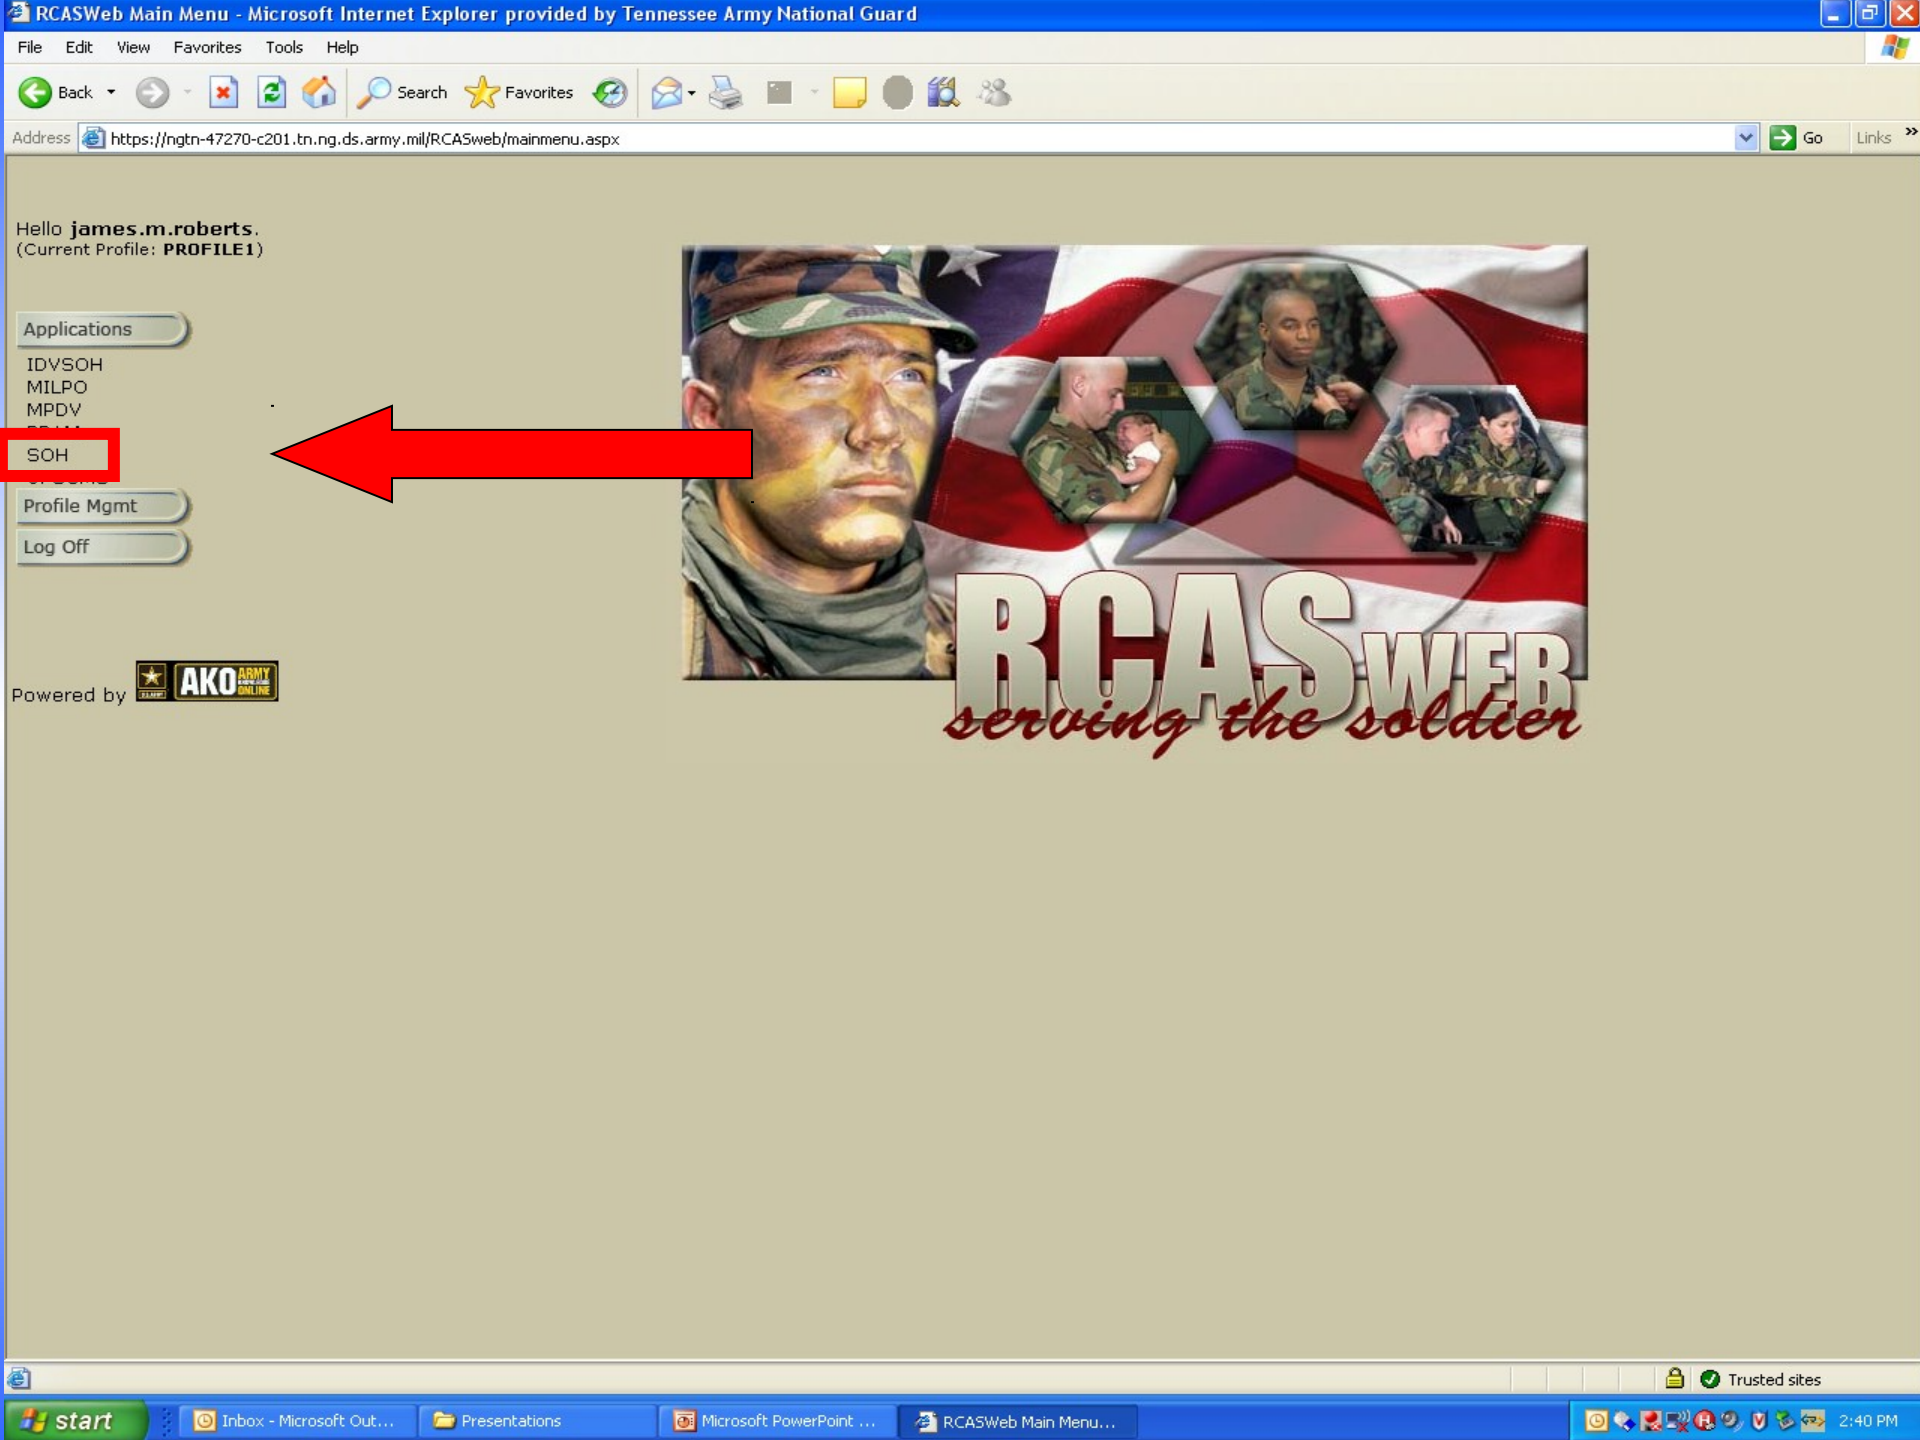

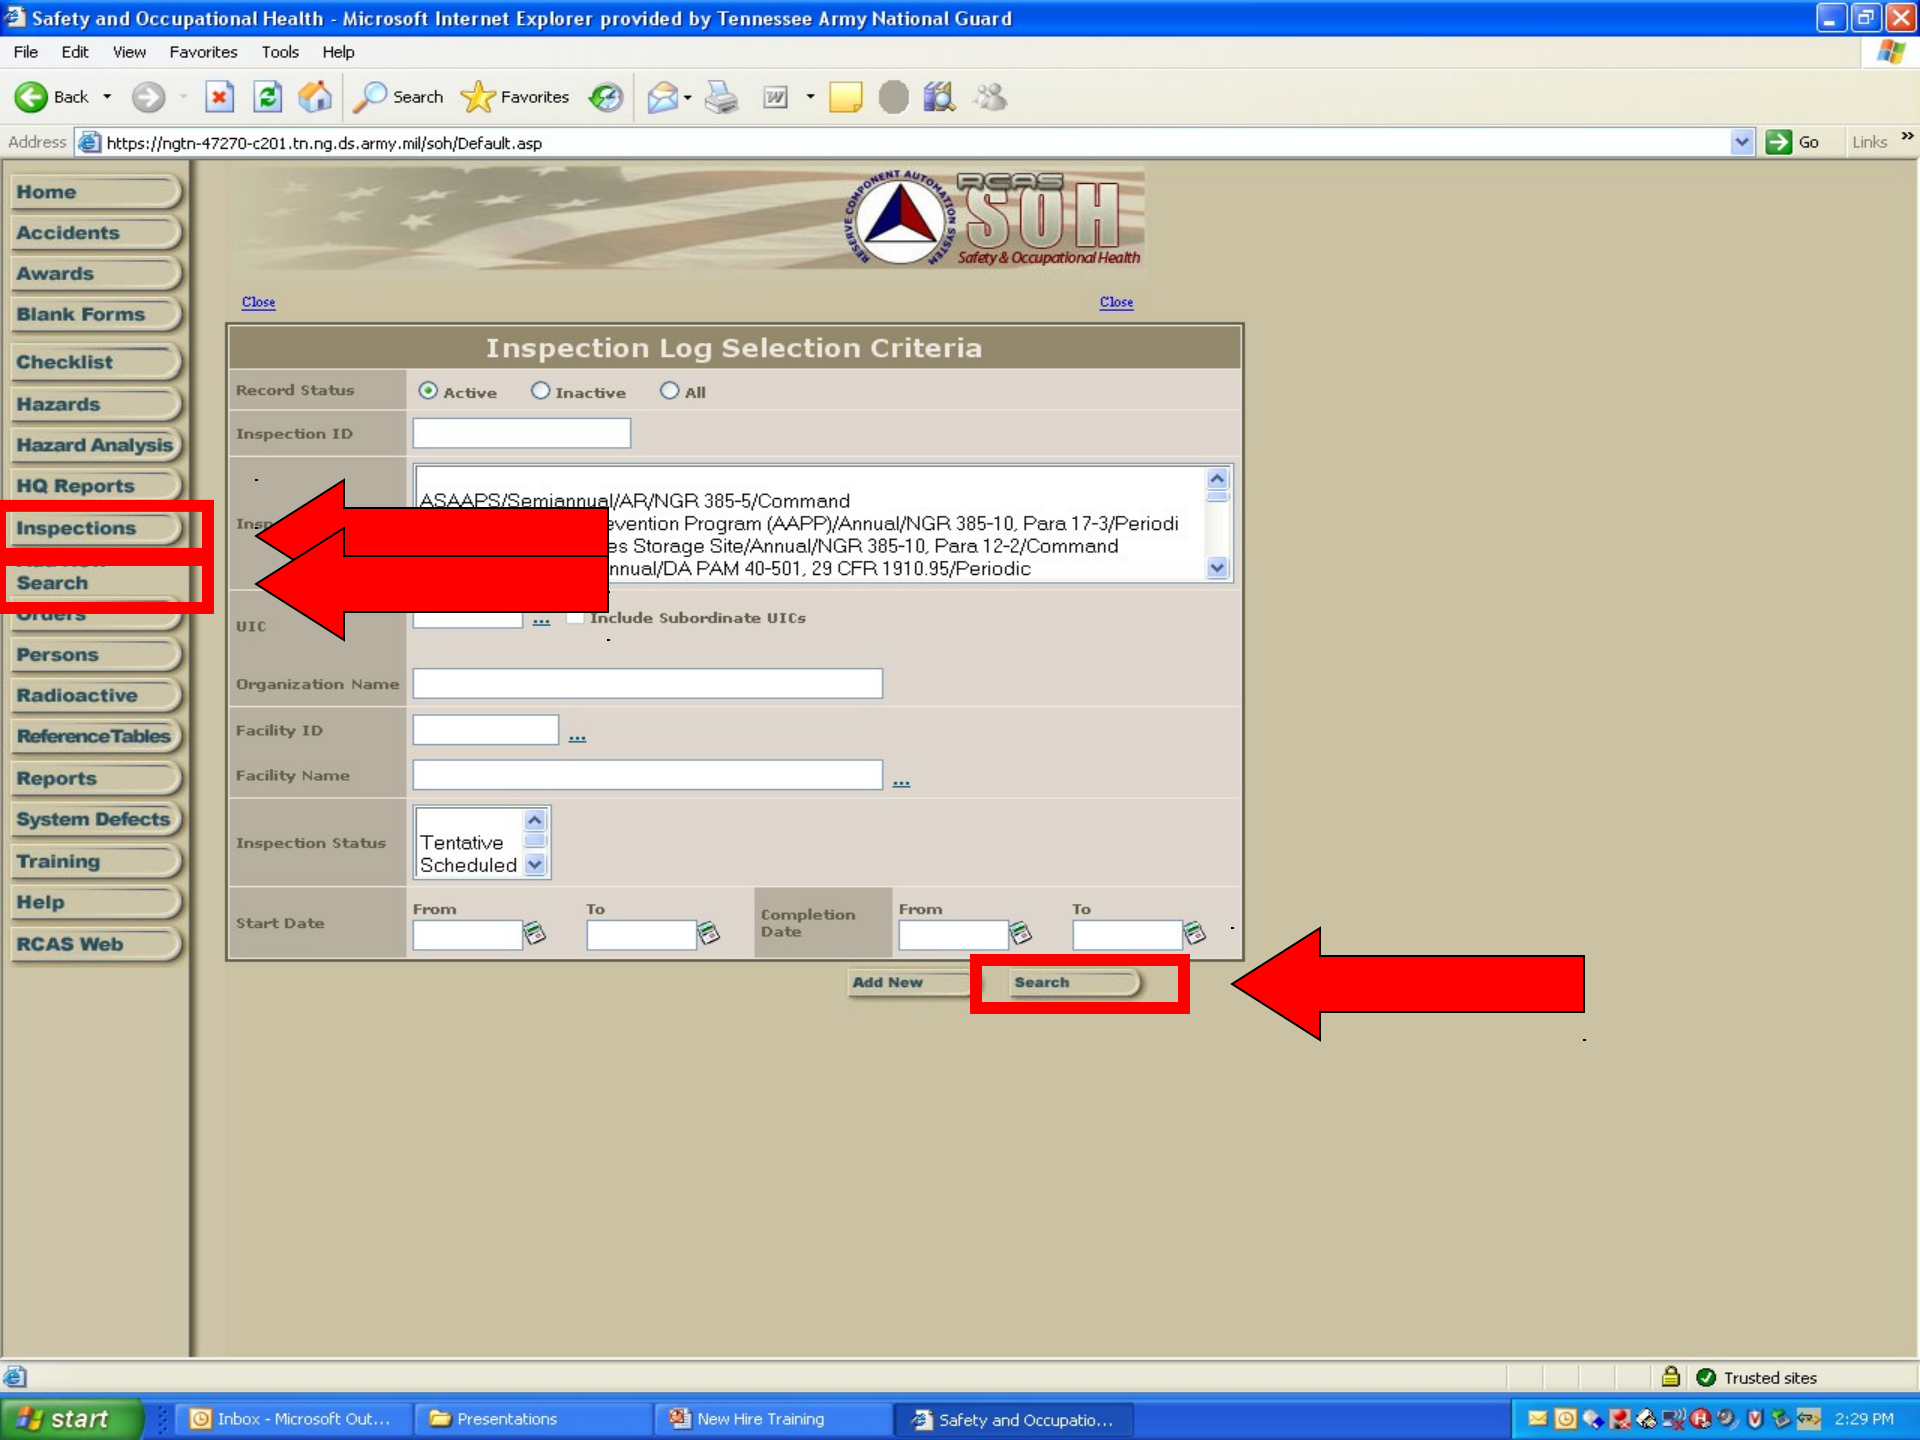

[Home](#)[Accidents](#)[Awards](#)[Blank Forms](#)[Checklist](#)[Hazards](#)[Hazard Analysis](#)[HQ Reports](#)[Inspections](#)[Add New Search](#)[Orders](#)[Persons](#)[Radioactive](#)[Reference Tables](#)[Reports](#)[System Defects](#)[Training](#)[Help](#)[RCAS Web](#)[Close](#)[Close](#)

Selection Criteria

Total Inspections Selected: 514

Inspection Log

Edit	Inspection ID	Record Status	UIC	Org Name	Facility ID	Facility Name	Start Date	Completion Date	Inspection Type	Inspection Status
Edit	2009-00068	Active	W8T106	W8T1 TN ARNG FMS 6	47B95-00002	LEBANON FMS 6	03/13/2009		SASOHI	Scheduled
Edit	2009-00067	Active	WX4XAA	SPECIAL TRPS SQDN 278 BN TOTL	47B95-00001	LEBANON ARMORY	03/12/2009		SASOHI	Scheduled
Edit	2009-00066	Active	WX4WT1	DET 1 HHT 2ND SQDN 278TH ACR	47B20	GALLATIN	03/11/2009		SASOHI	Scheduled
Edit	2009-00065	Active	WTQ0E1	DET 1 TRP E SPT SQDN 278TH ACR	47B79	LAFAYETTE	03/11/2009		SASOHI	Scheduled
Edit	2009-00064	Active	WTQ0E1	DET 1 TRP E SPT SQDN 278TH ACR	47A38	GORDONSVILLE	03/11/2009		SASOHI	Scheduled
Edit	2009-00063	Active	WVAGA1	DET 1 777TH MAINT CO	47D55	SPARTA	03/10/2009		SASOHI	Scheduled
Edit	2009-00062	Active	W8T104	W8T1 TN ARNG FMS 4	47A80-00002	COOKEVILLE FMS 4	03/09/2009		SASOHI	Scheduled
Edit	2009-00061	Active	WX4WT0	HHT(-) 2ND SQDN 278TH ACR	47A80-00001	COOKEVILLE ARMORY	03/09/2009		SASOHI	Scheduled
Edit	2009-00060	Active	WX4WC0	TRP G 2ND SQDN 278TH ACR	47A90	CROSSVILLE	02/13/2009		SASOHI	Scheduled
Edit	2009-00059	Active	WX4WD0	TRP H 2ND SQDN 278TH ACR	47D15	ROCKWOOD	02/13/2009		SASOHI	Scheduled
Edit	2009-00058	Active	W8T102	W8T1 TN ARNG FMS 2	47B60-00002	KNOXVILLE FMS 2	02/12/2009	02/26/2009	SASOHI	Completed
Edit	2009-00057	Active	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	02/12/2009	02/26/2009	SASOHI	Completed
Edit	2009-00056	Active	WX4XB0	TRP B SPC TRPS SQDN 278 ACR	47B71	KNOXVILLE CONCORD ST	02/12/2009	02/26/2009	SASOHI	Completed
Edit	2009-00055	Active	WX57AA	HHT 278TH ARMORED CAVALRY REGT	47B70	KNOXVILLE SUTHERLAND	02/12/2009	02/26/2009	SASOHI	Completed
Edit	2009-00054	Active	W8R5AA	W8R5 TN ARNG AASF 2	47B77-00002	LOUISVILLE AASF#2	02/11/2009	02/26/2009	SASOHI	Completed
Edit	2009-00053	Active	WV7PG2	DET 2 TRP G 1ST SOD 230	47B77-00001	LOUISVILLE ARMORY	02/11/2009	02/26/2009	SASOHI	Completed

Home

Accidents

Add Aviation

Search

Awards

Blank Forms

Checklist

Hazards

Hazard Analysis

HQ Reports

Inspections

Orders

Persons

Radioactive

Reference Tables

Reports

System Defects

Training

Help

RCAS Web



Close

Close

Selection Criteria

Total Hazards Selected: 3218

Hazard Log

Edit	Hazard ID	Rec Status	Hazard Title	Affected UIC	Affected Org Name	Facility ID	Facility Name	Hazard Status	Hazard Abatement Target Date	Event Source	Event Date	Affected Area	RAC	Recurring Hazard
Edit	2009-00496	Active	No trained Ammunition Handlers on Site	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT			Open		Missile Mishap	01/27/2009		3-Moderate	N
Edit	2009-00495	Active	No Safety representative available at the training	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT			Open		Missile Mishap	01/27/2009		3-Moderate	N
Edit	2009-00494	Active	No Ammunition Safety SOP exists	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT			Open		Missile Mishap	01/27/2009		3-Moderate	N
Edit	2009-00493	Active	POL Facility Marking	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00492	Active	Crane Operators Trained	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00491	Active	Jack And Floor Crane Marking	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00490	Active	Kitchen Range Exhaust	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RG	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00489	Active	Flammable Storage Cabinet Label	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RG	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		4-Low	N
Edit	2009-00488	Active	Floor jack, tire jack and jack stands outdated.	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RG	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00487	Active	Emergency Eye Wash/ Shower	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RG	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		2-High	N
Edit	2009-00486	Active	Electrical Box And Conduit Attachment	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RG	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00485	Active	Fire Extinguisher Mounting	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RG	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-	Active	Ref & coffee	WV7PG2	DET 2 TRP G	47B77-	LOUISVILLE	Open		Periodic	02/26/2009		2-High	N

- Home
- Accidents
- Add Aviation
- Add Ground
- Search
- FATS Download
- Awards
- Blank Forms
- Checklist
- Hazards
- Hazard Analysis
- HQ Reports
- Inspections
- Orders
- Persons
- Radioactive
- Reference Tables
- Reports
- System Defects
- Training
- Help
- RCAS Web



[Close](#)

[Close](#)

Selection Criteria

Total Accidents Selected: 123

Accidents Log

Edit	Accident ID	Serial Number	Record Status	Category	Class	Date	Short Title	Involved UIC	Involved Org Name	Accountable UIC	Accountable Org Name	Report Completion Date
Edit	2009-00025		Active	Ground	D	01/27/2009	Damaged 2.75 inch Hi Explosive Rockets \$7800.00	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT	
Edit	2009-00024		Active	Ground	R	02/25/2009	Suicide Non Duty (M-Day)	WX4WE0	ENGINEER TRP(-) 2D SQD 278 ACR	WX4WE0	ENGINEER TRP(-) 2D SQD 278 ACR	03/04/2009
Edit	2009-00023		Active	Ground	D	01/17/2009 11:00:00 PM	Avon Park Gunnery - Broken Arm	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RGT	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV RGT	02/20/2009
Edit	2009-00022	7037829	Active	Aviation	C	01/17/2009 04:00:00 PM	M-4 Gunnery from OH-58D \$82,518.00	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT	02/20/2009
Edit	2009-00021	9500025	Active	Aviation	D	01/21/2009 03:10:00 PM	Rocket Pod Shot \$ 7,460.00	WV7PB0	TRP B 1ST SQDN 230TH CAV REGT	WV7PB0	TRP B 1ST SQDN 230TH CAV REGT	02/20/2009
Edit	2009-00020		Active	Ground	R	01/16/2009 07:00:00 AM	SM Slipped on Ice	W8T116	W8T1 TN ARNG FMS 16	W8T116	W8T1 TN ARNG FMS 16	01/22/2009
Edit	2009-00019		Active	Ground	R	11/08/2008 08:00:00 AM	GSA G61-1312D Accident / Campbell / \$950.57	W77746	TNARNG REC & RET DETACHMENT	W77746	TNARNG REC & RET DETACHMENT	01/22/2009
Edit	2009-00018	G10-1051D	Active	Ground	D	12/18/2008 07:45:00 PM	GSA Sedan Tag #G10-1051D / Spears/ \$ 7,175.00	W77746	TNARNG REC & RET DETACHMENT	W77746	TNARNG REC & RET DETACHMENT	01/22/2009
Edit	2009-00017		Active	Ground	R	12/18/2008 11:00:00 AM	Motorcycle Accident (Non Duty Status)	WPNUAA	730TH QM CO (-)	WX6VAA	176TH COMBAT SUST SPT BN	01/30/2009
Edit	2009-00016		Active	Ground	R	12/14/2008	Suicide Non Duty (M-Day)	WV7PG0	TRP G(-) 1ST SQD 230TH CAV RGT	WV7PG0	TRP G(-) 1ST SQD 230TH CAV RGT	01/05/2009
Edit	2009-00015		Active	Ground	R	11/16/2008 07:30:00 AM	POV Crash (Enroute to Scheduled Drill Assembly)	WPD9T0	HHC 230TH SUSTAINMENT BDE	WPD9T0	HHC 230TH SUSTAINMENT BDE	12/18/2008
Edit	2009-00014		Active	Ground	R	11/15/2008 07:00:00 AM	POV Crash (Enroute to Scheduled Drill Assembly)	WXC4AA	268TH MP CO (-) (CS)	WXC4AA	268TH MP CO (-) (CS)	12/18/2008
Edit	2009-00013		Active	Ground	R	11/15/2008 04:30:00 PM	POV Crash (IDT Status)	WX4UA1	DET 1 TRP A 1ST SQDN 278TH ACR	WX4UA1	DET 1 TRP A 1ST SQDN 278TH ACR	12/18/2008

ACCIDENT INVESTIGATION



- Accidents are investigated, not to find fault or to blame, but to find out the Root Cause (Safety Committee, Union & Management)
- Get the who, what, when, where & why
- Careless is unacceptable “cause”
- Develop a plan for preventing the accident in the future

Home

Accidents

Awards

Blank Forms

Checklist

Hazards

Add New

Search

Hazard Analysis

HQ Reports

Inspections

Orders

Persons

Radioactive

Reference Tables

Reports

System Defects

Training

Help

RCAS Web

Close

Open

Hazard Log Selection Criteria

Record Status

☒ Active ☐ Inactive ☐ All

Hazard ID

Hazard Status

Event Source

Event Date

From

To

Target Date

☐ Abatement ☐ Corrective Action ☐ No Target Date

From

To

Hazard Title

Affected UIC

...

☐ Include Subordinate UICs

Affected Organization Name

Responsible UIC

...

☐ Include Subordinate UICs

Responsible Organization Name

Facility ID

...

Facility Name

...

Affected Area

Unassigned

ALSE Shop

Contributing Factors

Primary Management Program

Program Manager Title

Action

start

Inbox - Microsoft Out...

Presentations

New Hire Training

Safety and Occupatio...

Trusted sites

2:36 PM

- Home
- Accidents
- Awards
- Blank Forms
- Checklist
- Hazards
- Add New Search
- OSHA Reference
- Hazard Analysis
- HQ Reports
- Inspections
- Orders
- Persons
- Radioactive
- Reference Tables
- Reports
- System Defects
- Training
- Help
- RCAS Web

[Close](#)

[Open](#)

Selection Criteria

Total Hazards Selected: 3218

Hazard Log

Edit	Hazard ID	Rec Status	Hazard Title	Affected UIC	Affected Org Name	Facility ID	Facility Name	Hazard Status	Hazard Abatement Target Date	Event Source	Event Date	Affected Area	RAC	Recurring Hazard
Edit	2009-00496	Active	No trained Ammunition Handlers on Site	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT			Open		Missile Mishap	01/27/2009		3-Moderate	N
Edit	2009-00495	Active	No Safety representative available at the training	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT			Open		Missile Mishap	01/27/2009		3-Moderate	N
Edit	2009-00494	Active	No Ammunition Safety SOP exists	WV7PT2	DET 2 HHT 1ST SQDN 230 CAV RGT			Open		Missile Mishap	01/27/2009		3-Moderate	N
Edit	2009-00493	Active	POL Facility Marking	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00492	Active	Crane Operators Trained	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00491	Active	Jack And Floor Crane Marking	W8WTAA	W8WT TN ARNG CSMS 3	47B71-00007	KNOXVILLE CSMS EAST	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00490	Active	Kitchen Range Exhaust	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00489	Active	Flammable Storage Cabinet Label	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		4-Low	N
Edit	2009-00488	Active	Floor jack, tire jack and jack stands outdated.	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00487	Active	Emergency Eye Wash/ Shower	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		2-High	N
Edit	2009-00486	Active	Electrical Box And Conduit Attachment	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00485	Active	Fire Extinguisher Mounting	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		3-Moderate	N
Edit	2009-00484	Active	Ref & coffee pot plugged into power strip room 211	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		2-High	N
Edit	2009-00483	Active	Sleeping quarters with no smoke detector	WV7PG2	DET 2 TRP G 1ST SQD 230 CAV R G	47B77-00006	LOUISVILLE READINESS CENTER	Open		Periodic Safety Inspection / Survey	02/26/2009		1-Extremely High	N



LTC Terry Kiehn
SOH Manager
615-313-0567
Cell 615-418-3624

MAJ James Roberts
Safety Specialist
615-313-3126
Cell 615-517-0989

SFC Harvey White
Safety Specialist
615-313-3124
Cell 615-330-0430

OFFICE FAX: 615-313-
0720